

PC Evaluation Software PCA3000

B 70.9701.0 Operating Manual

07.06/00420775



An eLearning course on the PC Evaluation software PCA3000 is provided for you on the Internet. The course gives you step-by-step instructions on how to use the PCA3000 to evaluate measurement data. The most important software functions are also illustrated.

The course is available free of charge, and no license is needed.

For more information visit: **<http://eLearning.jumo.info>**

Contents

1	Introduction	7
1.1	Preface	7
1.2	Typographical conventions	8
2	PC Evaluation Software	11
2.1	General	11
2.2	Instruments with FDA compliance	11
2.3	Hardware and software requirements	12
3	Installation	13
3.1	Starting the installation	13
4	Log-in to the program	17
5	User interface	19
5.1	Elements of the user interface	19
6	Guide	21
6.1	Introduction	21
6.2	Reading in data	22
6.3	Opening the archive	24
6.3.1	Selecting the time period	26
6.4	Backing up data	28
6.5	Archive and evaluation directory	31
7	Evaluation - General	33
8	Evaluation - Graphics area	35
9	Evaluation - Table area	41
9.1	Switching registers into/out of display	42

Contents

9.2 Channels	45
9.2.1 The functions of the left mouse button	46
9.2.2 Displays (cannot be altered directly)	47
9.2.3 The functions of the right mouse button	48
9.3 Report	49
9.3.1 The functions of the left mouse button	49
9.3.2 The functions of the right mouse button	51
9.4 Events	53
9.4.1 The functions of the left mouse button	53
9.4.2 The functions of the right mouse button	53
9.5 Audit trail	56
9.5.1 The functions of the left mouse button	56
9.5.2 The functions of the right mouse button	56
9.6 Batches	58
9.6.1 The functions of the left mouse button	58
9.6.2 The functions of the right mouse button	58
9.7 Batch signature (PC signature for batches)	62
9.7.1 The functions of the left mouse button	62
9.7.2 The functions of the right mouse button	62
9.8 Log-off signature (PC signature for time period)	64
9.8.1 The functions of the left mouse button	64
9.8.2 The functions of the right mouse button	64
9.9 Analog: Group...	65
9.9.1 The functions of the left mouse button	65
9.9.2 The functions of the right mouse button	65
9.10 Digital: Group...	66
9.11 Printing	67
9.12 Data export	70
10 Menu functions and toolbar	73
10.1 Archive	73
10.2 Editing	78
10.3 Zoom	80
10.4 View	81
10.5 Extras	81

Contents

10.6 Window	82
10.7 Info	83
11 Options at program start	85
12 Index	87

Contents

1.1 Preface



Please read this operating manual before commissioning the software. Keep the manual in a place that is accessible to all users at all times.

Please assist us to improve this operating manual, where necessary.

Your comments will be appreciated.



However, if any difficulties should arise during start-up, please do not carry out any unauthorized manipulations. You could endanger your rights under the instrument warranty!

Please contact the nearest subsidiary or the head office in such a case.

1 Introduction

1.2 Typographical conventions

Warning signs

The symbols for **Danger** and **Caution** are used in this manual under the following conditions:

Caution



This symbol is used when there may be **damage to equipment or data** if the instructions are ignored or not followed correctly!

Note signs

Note



This symbol is used when your **special attention** is drawn to a remark.

Reference



This symbol refers to **further information** in other manuals, chapters or sections.

Footnote

abc¹

Footnotes are remarks that **refer to specific points** in the text. Footnotes consist of two parts:

A marker in the text, and the footnote text.


The markers in the text are arranged as continuous superscript numbers.


Action

*

This symbol indicates that an **action to be performed** is described.

The individual steps are marked by this asterisk, e.g.

* Press the  key

* Confirm with 

Representation

Keys

 + 

Keys are **shown in a box**. Both **symbols and text** are possible. If a key has a multiple function, then the text shown is the one that corresponds to the function **that is active at the moment**.

Menu items

*Edit →
device data*

Menu items in the software which are referred to in this manual are shown in italics. Menu name, menu item and submenu item are separated from each other by “→”.

1 Introduction

2.1 General

The PC Evaluation software (PCA3000) is used for archiving and evaluating data (including device audit trail data, if available). In the software, an electronic signature can be attached to the archived data.

The PCA3000 is on a CD, together with:

- PCA Communications software (PCC),
- Setup software (only for specific instruments) and
- Documentation in the form of PDF files.



PCA3000 can be used for data from different instruments. Differences may occur between the operating manual and the individual instrument-specific functions.

2.2 Instruments with FDA compliance

The CD also contains:

- PC Security Manager software (PCS) and
- PC Audit Trail Manager software (PCAT).

For instruments with an increased security level, the software is freely available on the Internet in “read-only” mode (PCA3000 viewer), for purposes of FDA inspection and checking.

Anybody who has been authorized by the administrator is allowed to start and use PCA3000. The administrator uses the PC Security Manager software (PCS) to allocate authorizations.

PCA3000 is installed in conjunction with the installation of the PC Security Manager software (PCS). In this case, the installation will be different from the installation procedure described in Chapter 3 “Installation”.

2 PC Evaluation Software

2.3 Hardware and software requirements

The following hardware and software requirements have to be met for installing and operating the software:

Minimum configuration

- Intel Pentium¹ III or higher,
- Microsoft Windows² 2000 or XP,
- 256Mbyte main memory,
- CD drive,
- mouse,
- one free serial interface or network connection or CompactFlash memory cards (depending on the type of data transmission to the recorder) and
- 120Mbyte free space on hard disk.

Recommended configuration

- Intel Pentium 4
- Windows XP
- 512Mbyte main memory
- 2Gbyte free space on hard disk for data

1. Intel and Pentium are registered trademarks of the Intel Corporation
2. Microsoft and Windows are registered trademarks of the Microsoft Corporation

3.1 Starting the installation

Running the installation program

- * Start Microsoft Windows



If Microsoft Windows has already been started, all Windows programs have to be shut down before installing the setup program.

- * Insert CD into the disk drive, then close it.


After the CD has been inserted, the installation program starts automatically, if not, proceed as follows:

- * Start the file "Launch.exe" in the main directory of the CD.

Screen messages from the installation program will now lead you through the rest of the installation.

License agreement


- * Read and confirm the license agreement. Accepting the agreement is the basic precondition to be able to install the software.

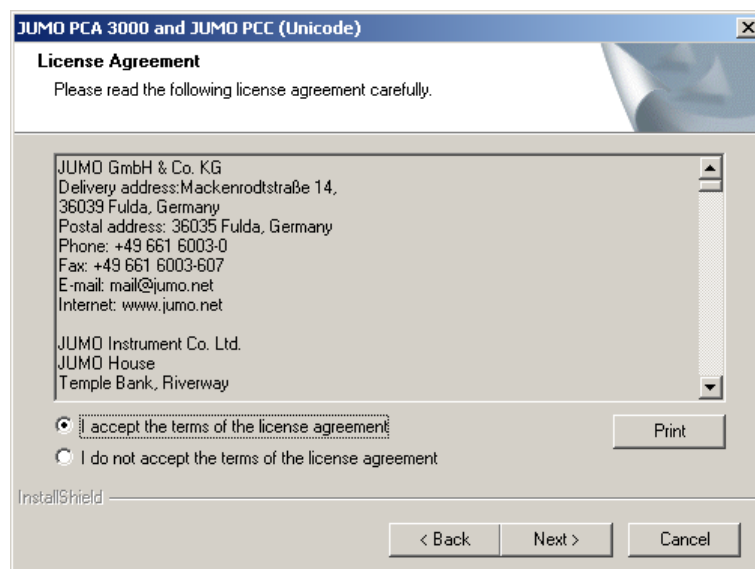

3 Installation

Available software


- * Select the components that need to be installed.

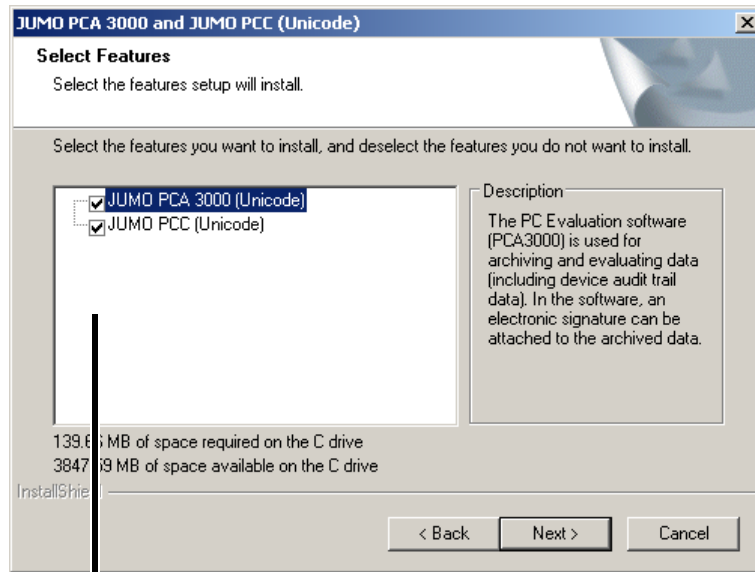

Software that is to be installed must be marked by a tick (☑).

License number

- * Now enter the required license numbers.

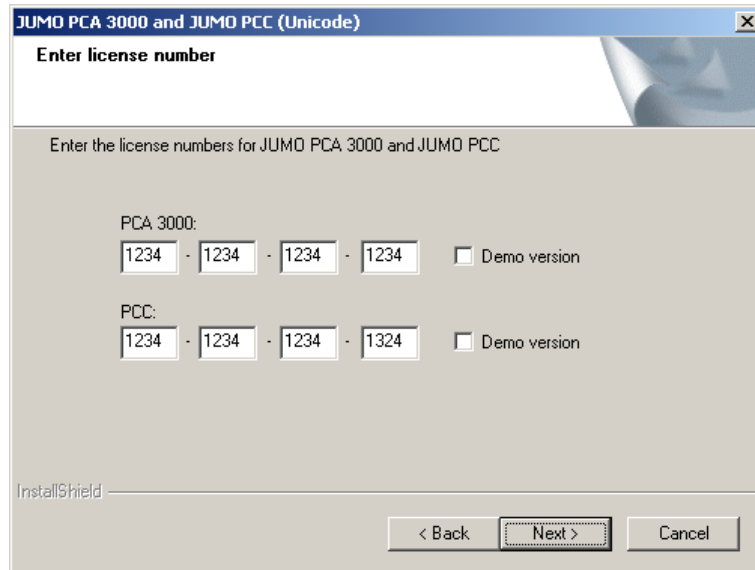

If the “demo version” option (viewer mode) has been set during installation, then some functions of this software (such as data transmission, saving data, printing out) will be disabled.


The software can be licensed at a later stage.

Program folder

Define the program folder into which the icons for starting the software are to be copied. The directory for the program files is determined automatically.

3 Installation

Installing

- * The final action is to click the  button, to initiate the actual installation.

Program start

The selected software components will now be installed. When the installation has been completed, start the PC Evaluation software (PCA3000) via the Windows start menu.

3 Installation

4 Log-in to the program


When the program is installed for the first time, there will be no query of the user name and password. The query at the program start can be activated in the *Extras* menu, by using the function *Renew log-in / Alter password*.

By activating the log-in function, it is possible to distinguish between the “Specialist” and “Maintenance” users. These users have different authorizations with regard to the functions of the setup program.

⇒ “Renew log-in / alter password” on page 81

When the query has been activated, proceed as follows:


* Log in.

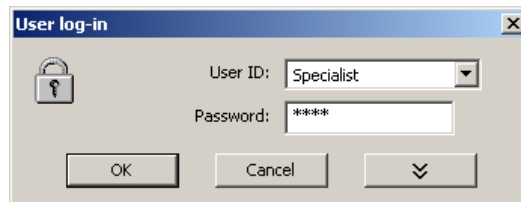

The image shows a dialog box titled "User log-in" with a close button (X) in the top right corner. On the left side, there is a lock icon. The dialog contains two input fields: "User ID:" with a dropdown menu showing "Specialist" and a small downward arrow, and "Password:" with a text box containing "****". At the bottom, there are three buttons: "OK", "Cancel", and a button with a downward-pointing arrow.

4 Log-in to the program

5.1 Elements of the user interface

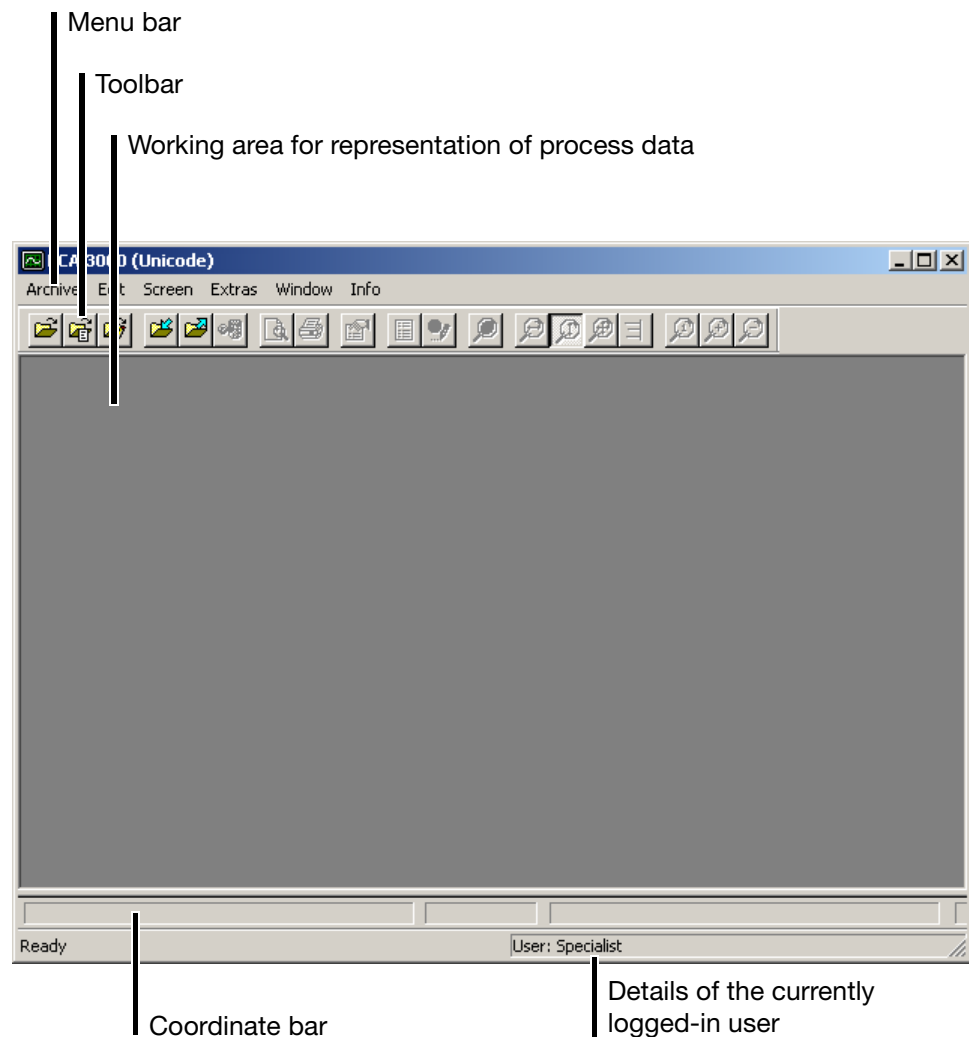

Menu bar

The individual functions of the software can be started by using the menu bar.
⇒ Chapter 10 "Menu functions and toolbar"

Toolbar

The toolbar contains selected functions from the menu bar. They can be started or activated by pressing the left mouse button. If you rest the mouse pointer on one of the icons (tool tips), you will see the function title after a short while.



5 User interface


Shift toolbar

The position of the toolbar can be changed, if desired.

- * Please move the mouse pointer between two icon groups.



- * Press the left mouse button.
- * Keeping the left mouse button pressed, drag the toolbar to the desired position.
- * Now release the mouse button.

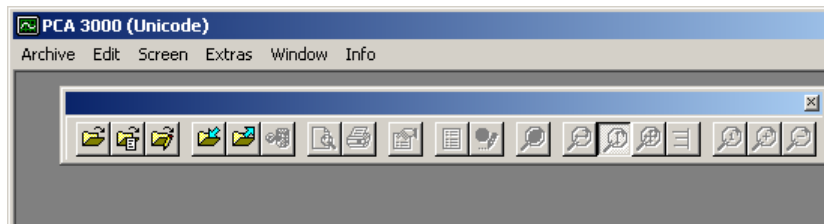

Possible positions are:

- the left or right window border (vertical orientation),
- below the menu bar (horizontal orientation),
- at the bottom edge, above the user details (horizontal orientation) or
- any position (in its own window - height and width can be changed using the mouse).

Working area

The process data are displayed here.

6.1 Introduction

The following pages are intended as a guide to familiarize you with the principle of the PC Evaluation software PCA3000.

For a better understanding, the concept is explained by analogy with conventional pen recorders and paper charts containing process data.


6 Guide

6.2 Reading in data

This chapter explains how you can read in and save recorder measurement data from a CompactFlash memory card to your PC. For a faster access during a subsequent visualization, a concept was chosen that is based on an archive and an evaluation.

Accordingly, the **archive** represents the conventional paper chart deposit, the **evaluation** the rolled out paper charts.


Practical experience has shown that most users initially only wish to save (archive) their measurement data. Data are taken out of the archive and analyzed only in the event of a fault or similar event.

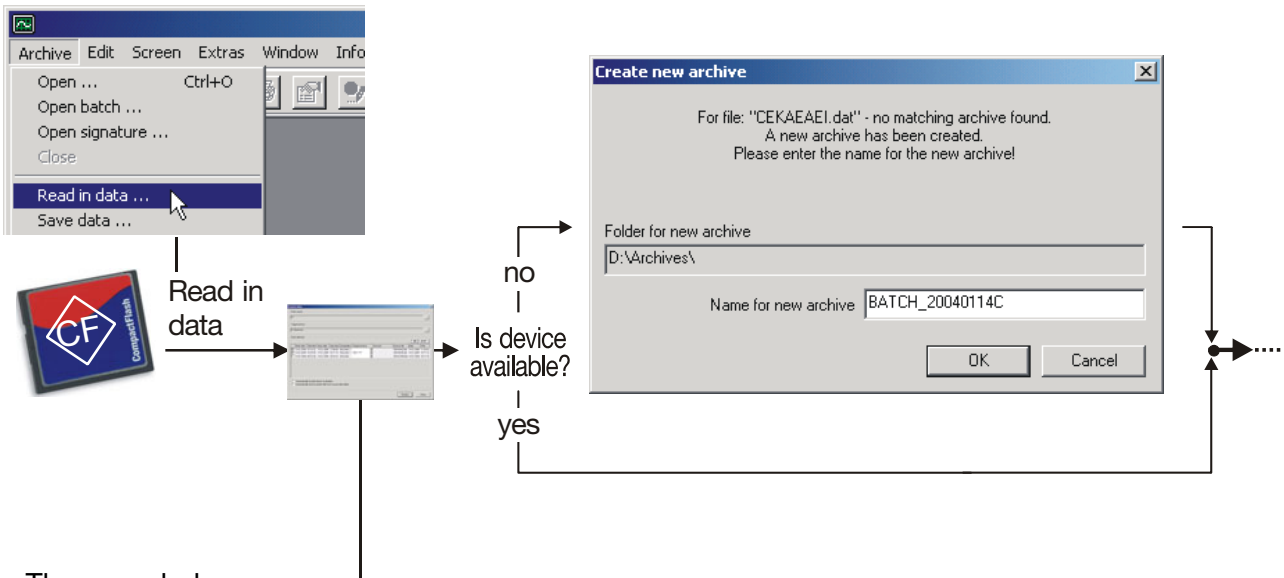

The recorded measurement data can be read in via the CompactFlash card or the interface.


The PCA communications software is used for reading in via the interface. (PCC).

Further important information: see "Read in data" on page 75.

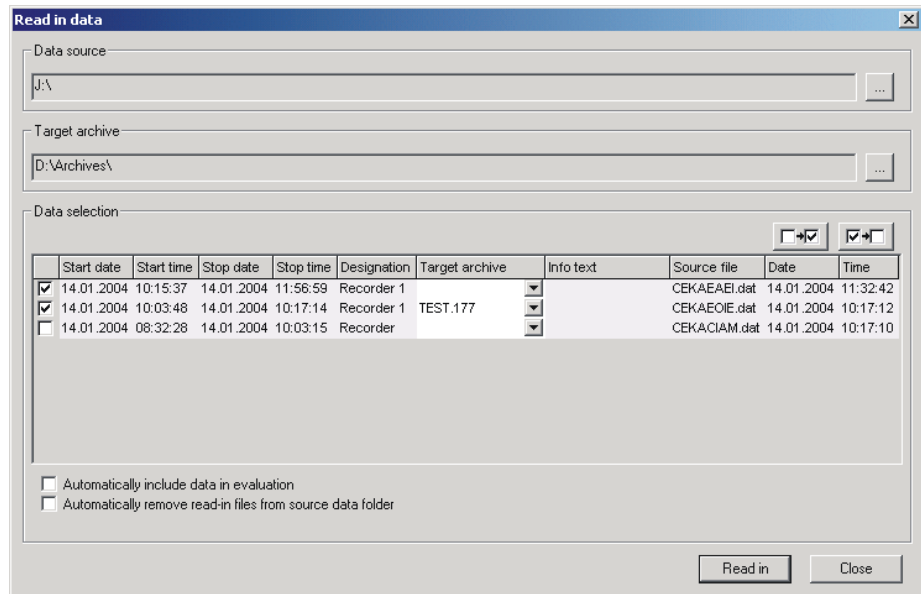



In contrast to the preceding PCA version, the archives of the PCA3000 software are not a directory with several files, but a single file only. This file always carries the file extension “.177”.

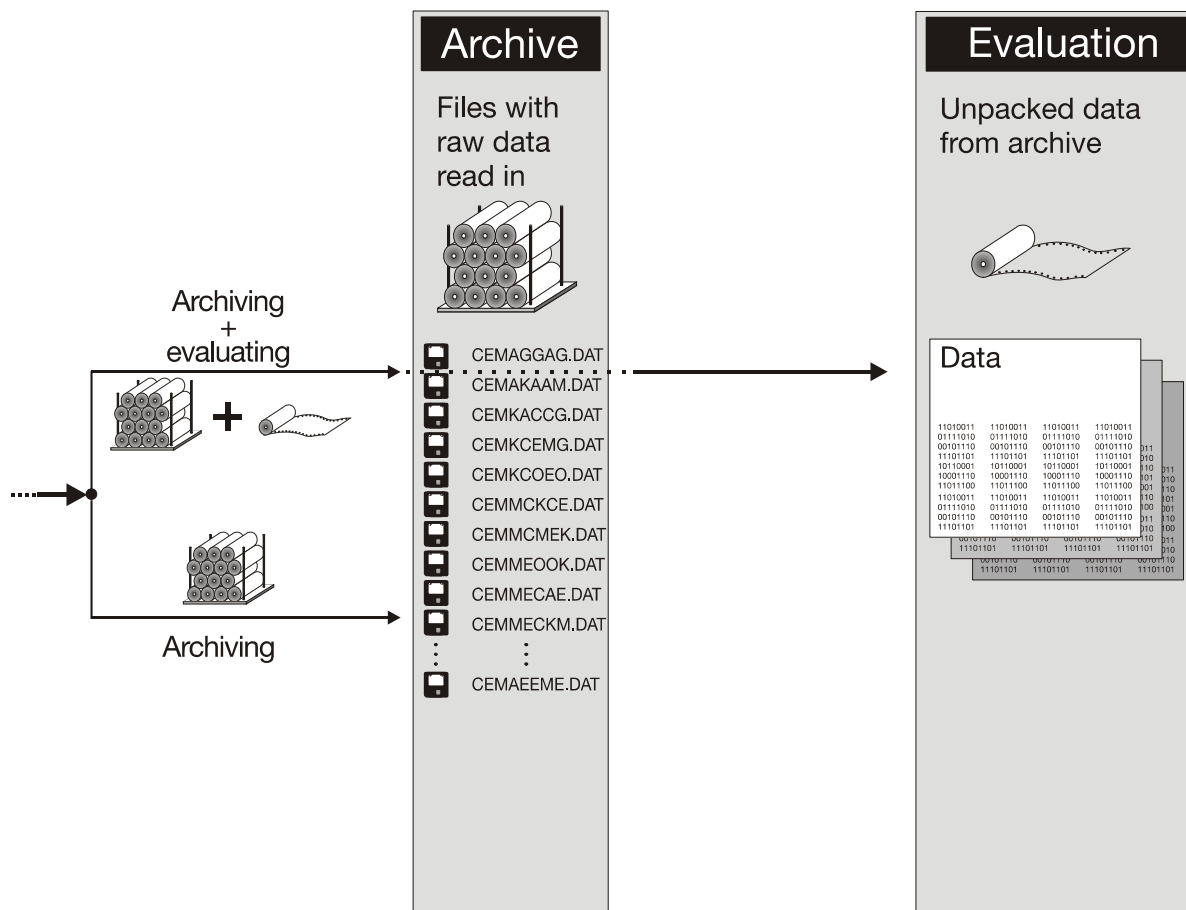

The archive directory and the evaluation directory are set within the PCA3000.

Archive

The default directory is set via the menu item *Archive* → *Default settings* → *File deposit* → *Directory for archives*. It can be altered at a later stage when reading in the data.

Evaluation

The default directory is set via the menu item *Archive* → *Default settings* → *File deposit* → *Directory for evaluation*. It cannot be altered when reading in data.



With extensive measurements, it may take some minutes for the measurement data to be entered into the archive.


6 Guide

6.3 Opening the archive



Measurement data which are to be visualized are opened from the **evaluation**.


If these data are not yet available in the **evaluation**, they must first be copied from the archive to the evaluation. This procedure is carried out automatically during opening.

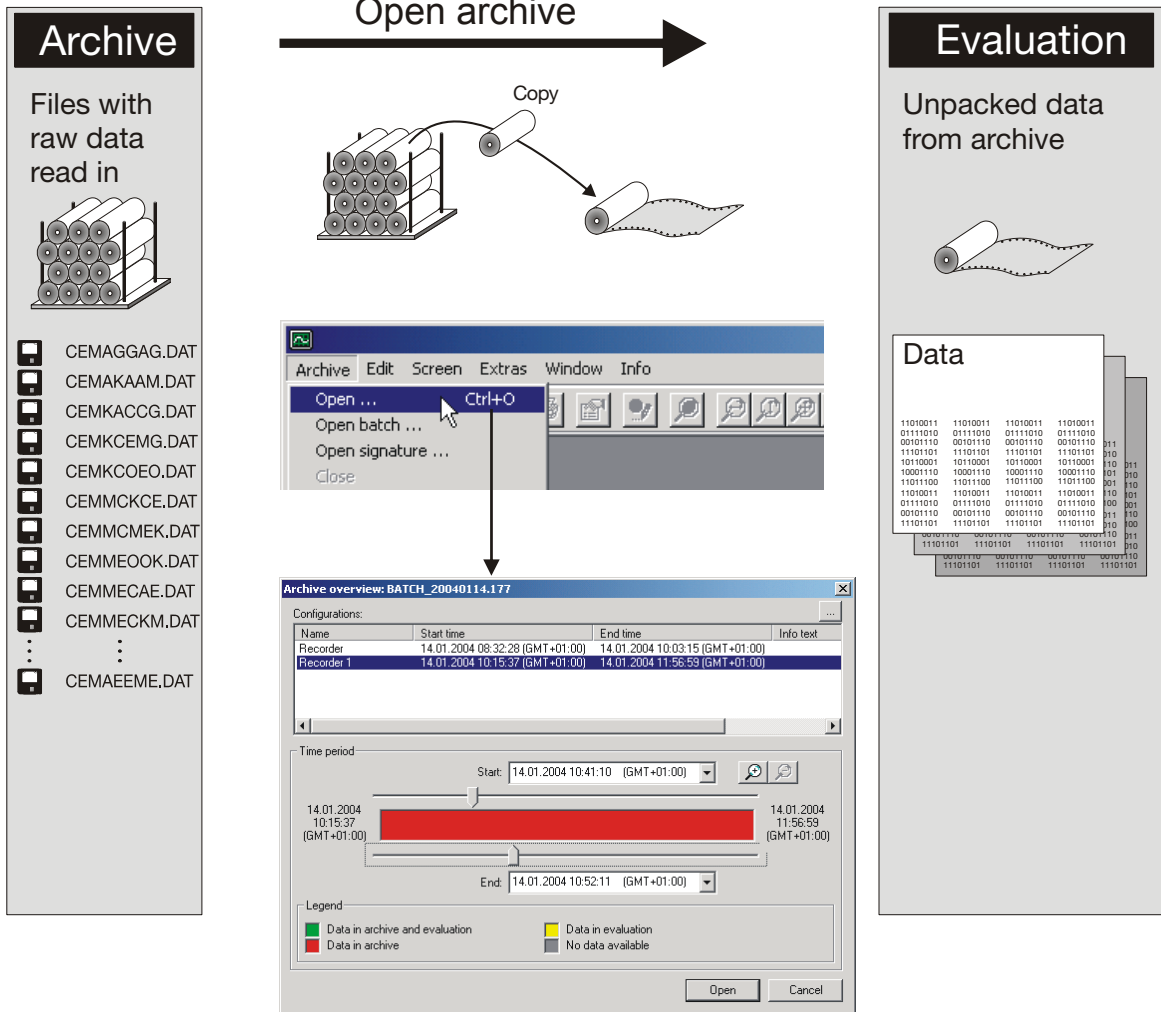




After **Archive** → **Open** has been selected, the time period is selected.

⇒ Chapter 6.3.1 "Selecting the time period"

Open archive



Visualization

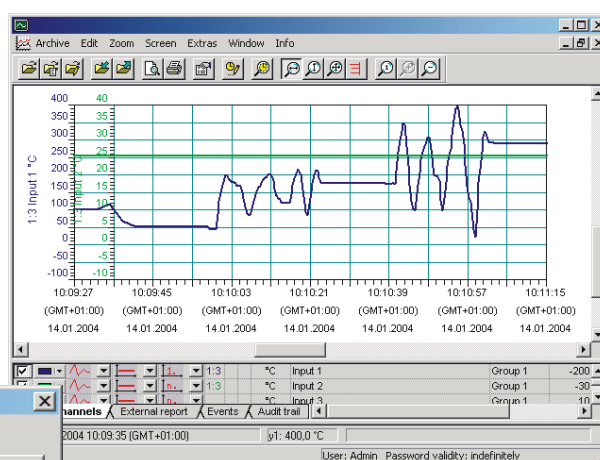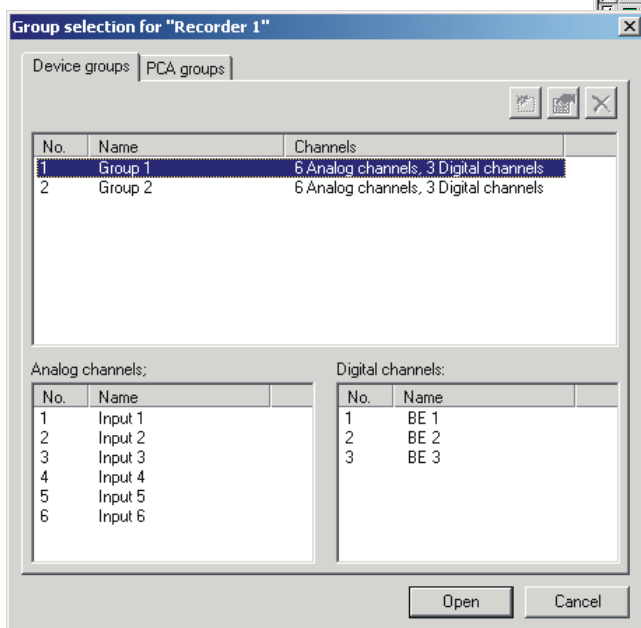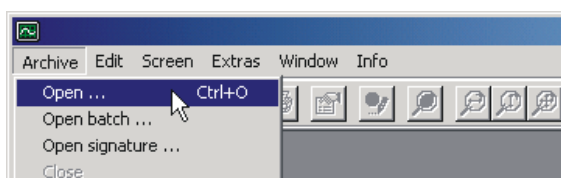

When the time period has been selected, the required group (as generated by the paperless recorder) is chosen before the measurement data are displayed. User-defined groups can be compiled in the register "PCA groups".


Further important information:
see "Open" on page 73.

6 Guide

6.3.1 Selecting the time period

Selecting a data set

Each entry represents a new configuration of a device.

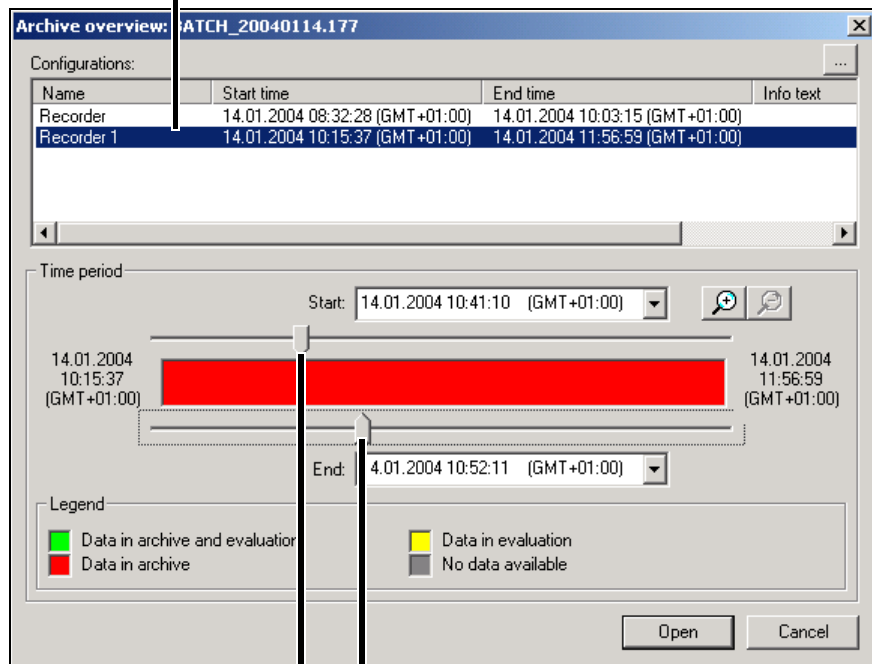


Selecting a time period

The period between the two sliders is shown graphically after activating the "Open" button.

Hold the left mouse button down when shifting the sliders.

Back
Set the time period that was last active.

Zoom
Zooms the time period between the sliders over the entire width. The sliders are repositioned.

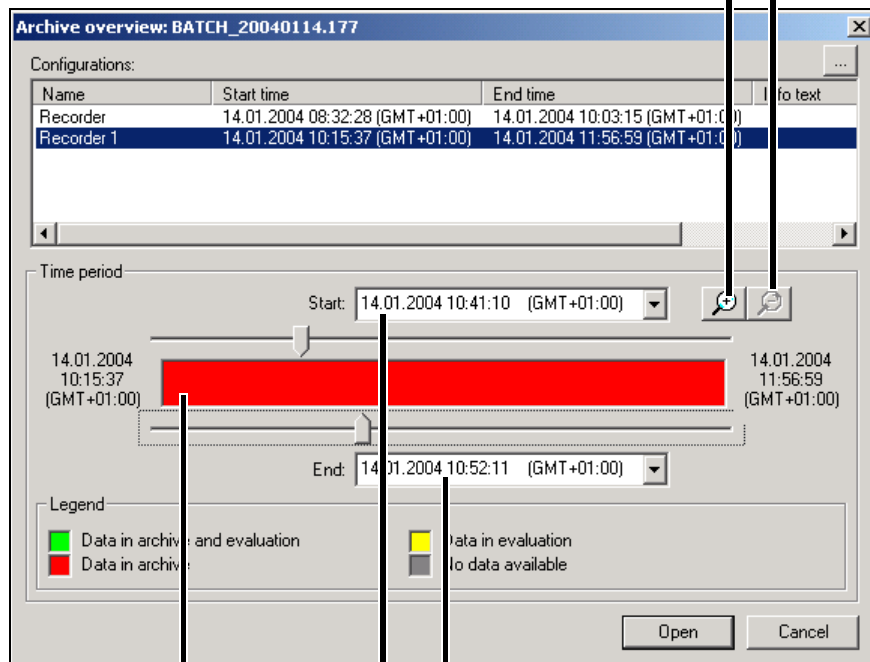

End time
A dialog box can be used to determine the end time.


Start time
A dialog box can be used to determine the start time.

Data in archive only
The data are only available in the archive. If they are selected for display, then the software will automatically accept them for evaluation.

6 Guide

6.4 Backing up data


Save data

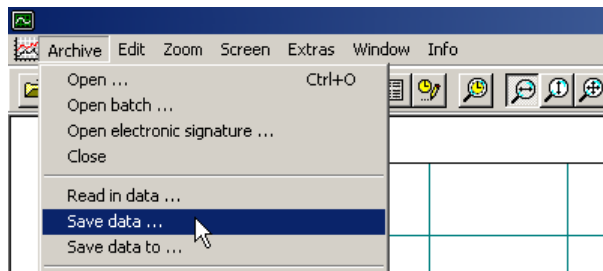

The *Save data* function serves to

- copy process data from an archive (e.g. for general data backup),
- copy process data from an archive to a protected archive (e.g. for passing them on for checks) and
- copy process data from an archive and simultaneously delete them (e.g. so that the archived files do not become unnecessarily large).

Save data as

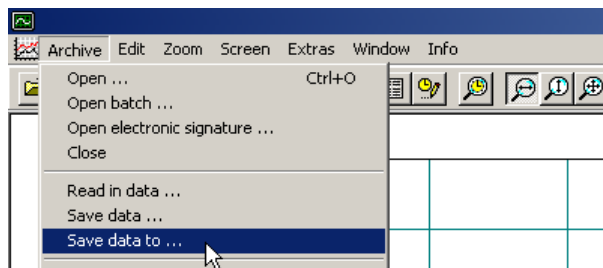

The *Save data as* function extends the *Save data* function by the possibility of protecting the records (protected archives). Protected archives differ from the other archives by:

- inhibiting the execution of signatures
- inhibiting the *Save* function (a fresh saving of data is prevented).
- a simplified opening of the protected data.
- protected data cannot be extended (no further read-in or appending of additional data).



The *Save data as* function is only available if the data are graphically displayed.

Save data



Selected archive

Select data according to time

Select data according to configuration

Select data according to batch

Select data according to signature

Archive selection

Save data

Source archive

D:\Archive_es\Batch_gb_0040114.177

Time Configuration Batch Signature

from:

to:

Remove data from source archive after saving

Backup archive

D:\Archive_es\20041123.177

Protect archive from alterations

Inhibit signature creation

Inhibit data save function

Backing up Close

Start data backup

Cancel data backup


Selected backup archive

A means that the data will be deleted from the archive after backup.

Select backup archive

6 Guide

Save data as

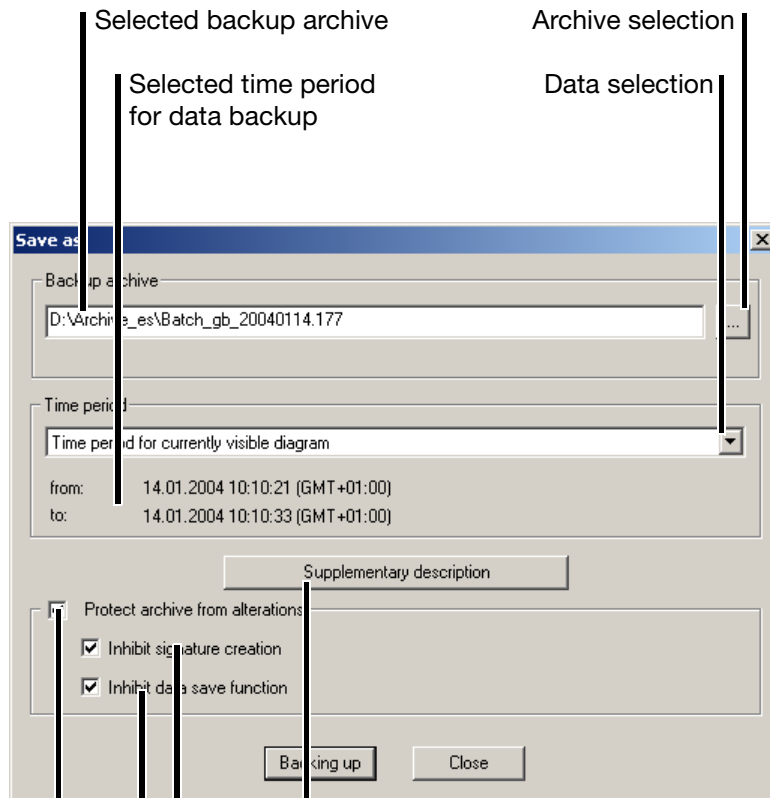

Selected backup archive

Archive selection

Selected time period
for data backup

Data selection

Additional text for describing the
protected archive.

⇒ Page 79

Prevent additional signings.


Prevent additional backing up of data.

Caution: If the option is inactive, a protected archive
that has already been protected can again be saved as
an unprotected one.

This protects the archive against alterations
(protected archives).


6.5 Archive and evaluation directory

- Archive file** The archive file may be located in a network. Several PCs may use an archive jointly.
- Evaluation directory** The evaluation directory must **not** be located in a network, but locally on the hard disk.
- File deposit** The directories (for archives and for evaluation) are preset in the PCA3000 software, in the menu *Archive* → *Default settings* → *File deposit*.

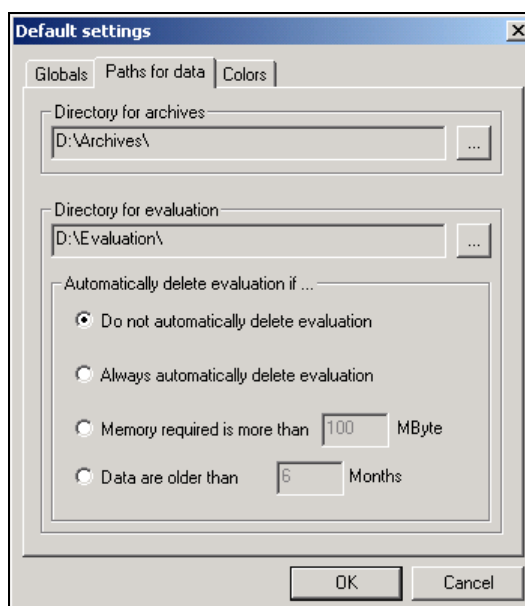

7 Evaluation - General

In Chapter 6.3 “Opening the archive” it has already been described how data are presented for evaluation (display). The graphical representation could look like this:

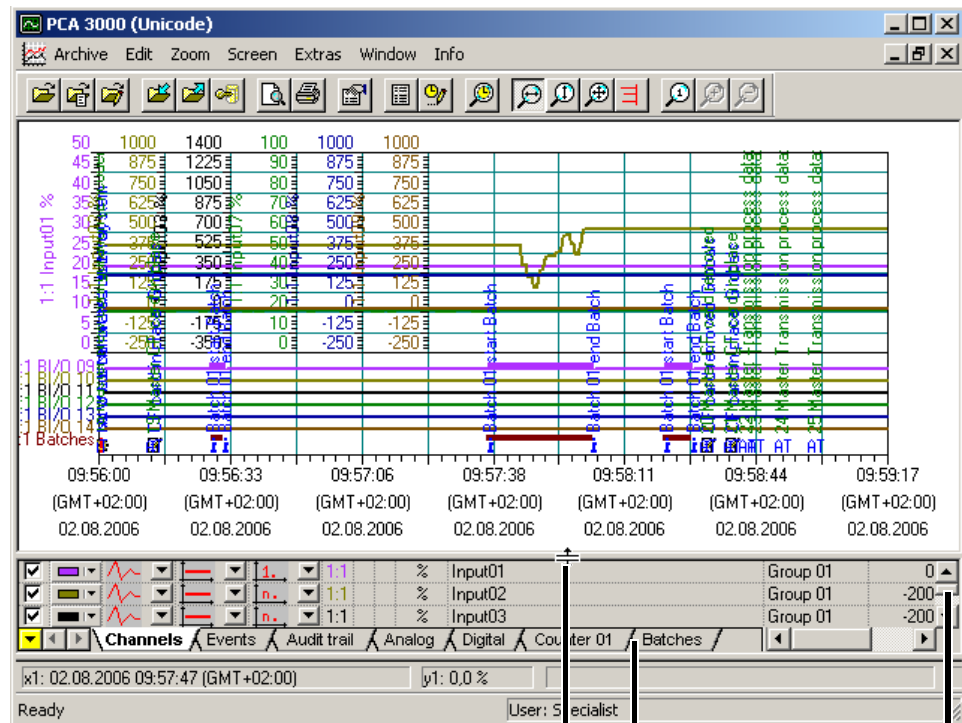

You can alter the window height by placing the mouse pointer between the graphics and the table area and moving the mouse up or down (keep left mouse button pressed).

Show additional columns in the table area (scroll columns).

Show additional rows in the table area (scroll rows).

The display is subdivided into

- a graphics area, in which the measured values are shown and
- a table area, which can be used to control the graphics and further functions.




The graphics display will appear faster, and will also be clearer, if less measurement data are used within it.

7 Evaluation - General

8 Evaluation - Graphics area

The graphics area is shared by the analog and digital signals. The analog signals always lie above the digital signals.

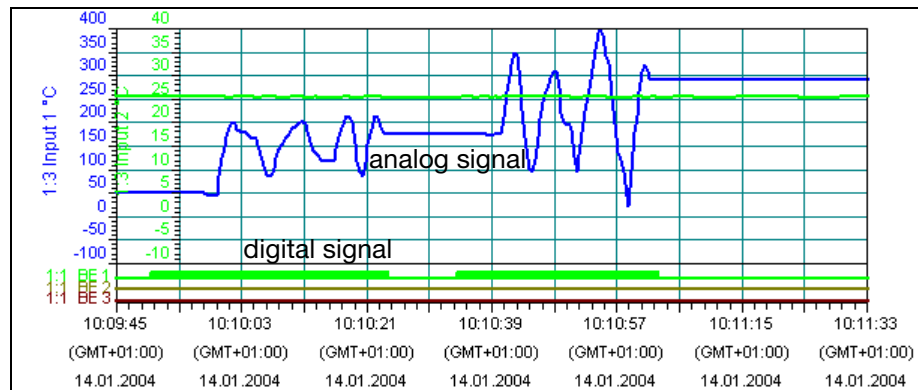

The most important control element within the graphics is the mouse. It is used to perform different functions.


Left mouse button

Normally, the left mouse button will produce a zoom in the X-direction.

- * Position the mouse pointer within the graphics.
- * Press the left mouse button and hold it down.
- * By dragging the mouse you can mark the time period that has to be enlarged.
- * Release the mouse button.

The graphics are automatically zoomed to the next possible time period. Please note that more process data may be displayed than have been selected.

The function of the left mouse button can be controlled via the toolbar of the software.

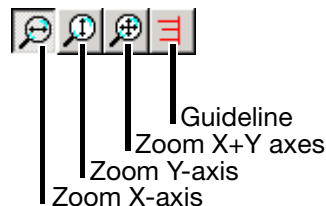


When using the Y-zoom, please note that the channels that have an auxiliary Y-axis (or no Y-axis) are zoomed at a fixed ratio to the main Y-axis. Consequently, the scaling range of the auxiliary Y-axes (or of the channels without Y-axes) is expanded under certain conditions.

A fixed ratio to the main Y-axis is thus ensured. The diagram curves will appear in the same relationship after the Y-zoom as before the zoom.

8 Evaluation - Graphics area

Right mouse button


If you use the right mouse button when the mouse pointer is within the graphics, a menu appears in which various functions can be selected.

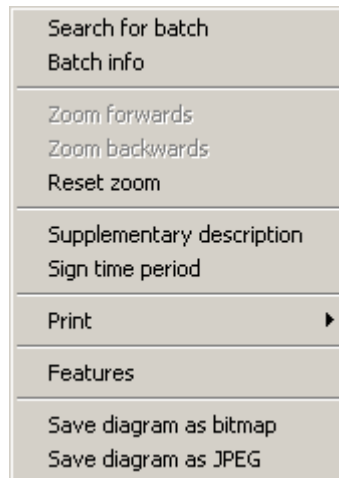

Search batch

When you have called up the function, a dialog box will appear if the archive file contains batch data.

Select the required options and give all the necessary details. After activating the button, the corresponding batch data will be automatically displayed over the entire width of the X-axis.

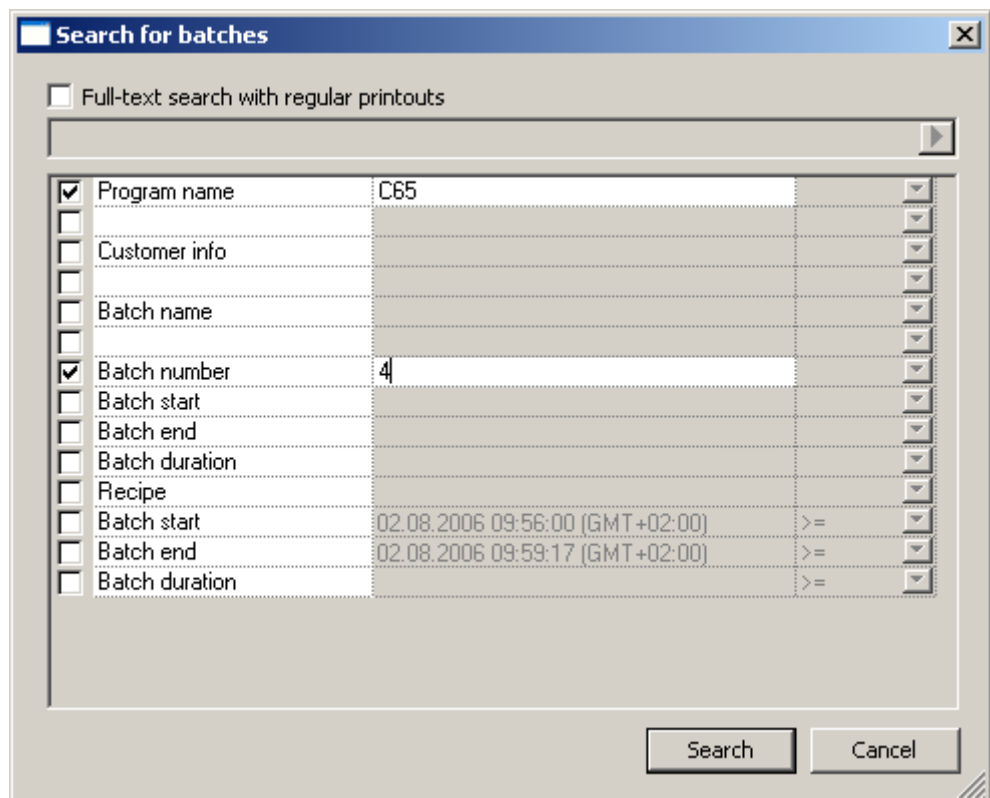

The specified search options will be AND-linked.


If no batch is found that matches the search options, the batch that occurs first will be shown.

8 Evaluation - Graphics area

Full-text search with regular expressions

The active “Full-text search with regular expressions” is also AND-linked with the individual batch search fields.

Use the  button in order to enter wildcards, or have them explained.

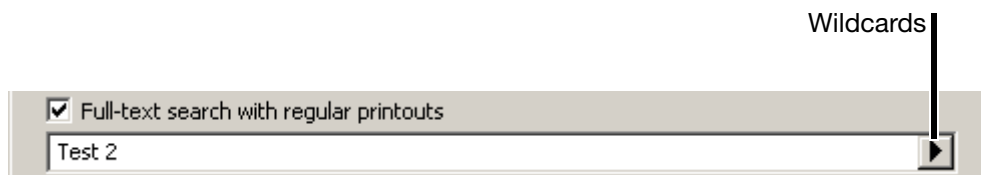

Batch info

This function shows the batch texts for the displayed batch. It only becomes available when the data of a specific batch have come into display by using the function *Search for batch*.

Zoom forwards (zoom in)



Zoom forwards is used to restore the next zoom display. This function is only available if *Zoom backwards* has been used previously. As an alternative to the mouse, *Zoom forwards* can also be executed from the PC keyboard (page up).

Zoom backwards (zoom out)



Zoom backwards is used to restore the last zoom display. This function is only available if zooming has been carried out. As an alternative to the mouse, *Zoom backwards* can also be executed from the PC keyboard (page down).

Supplementary description

The “Supplementary description” function is described on page 79.

Reset zoom



Reset zoom will restore the display of the entire time period for the selected evaluation. As an alternative to the mouse, *Reset zoom* can also be executed from the PC keyboard (Home).



If you want to use the PC keyboard for zooming, the graphics area must be the active window. If the table area is to be the active window, you will have to click on the graphics first.

Sign time period

This function can be used to sign the current contents of the graphics area. After calling up the function *Sign time period*, a submenu will appear in which you will be asked for the designation. The designation is defined in the device through the parameter *Configuration* → *El. Signature* → *Designation* → *Significance* and through the parameter *Configuration* → *El. Signature* → *Designation* → *El. signature*. When the designation has been selected, signing takes place by selecting the user ID and password.

8 Evaluation - Graphics area

Print After calling up the *Print* function, a submenu with additional functions appears:


- *Print preview*
- *Print*
- *Printer setup*

**Print →
Print preview** Here you can get a preview of the graphics print-out.

**Print →
Print** This will start the print output.

**Print →
Printer setup** This takes account of various printer properties (e.g. paper size and orientation).

Properties After calling up the *Properties* function, a dialog window will open. You can influence the graphics display and the function of the left mouse button by means of selectable parameters.

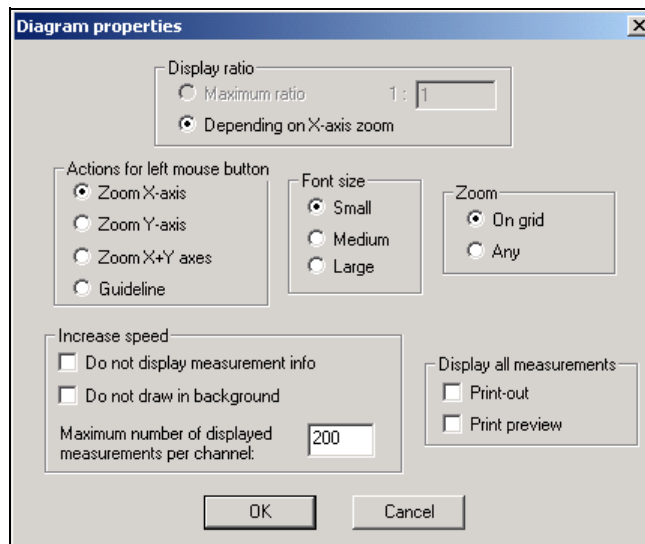

**Properties →
Display ratio** The setting cannot be altered here. Data are always displayed automatically using the setting “Depending on X-axis zoom”.

**Properties →
Actions for left mouse button** This determines the function of the left mouse button within the graphics. Normally, the left mouse button will produce a zoom in the X-direction.

If you choose the “Guideline” setting, then a vertical and a horizontal line (including the current amplitude and time values) will appear after pressing the left mouse button. The corresponding measurements are shown in the table area (the *Channels* table must be active).



8 Evaluation - Graphics area




The guideline is positioned with regard to the “real measured values”, i.e. it may diverge from the optical profile of the curve, since more measured values exist than are displayed.

The guideline can also be shifted from the PC keyboard by using the key combination Shift-Cursor left or Shift-Cursor right.



The function for the left mouse button can also be controlled via the toolbar of the software.

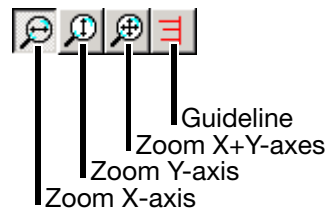

Properties → Font size

Use this setting to alter the size of the scaling for the X- and Y-axes.

Properties → Zoom


This setting can be used to influence the marking of a section that has to be spread. You can choose between continuous marking (*Any*) or marking at a fixed spacing (*Division*).

Properties → Increase speed

The options “*Do not display measurement info*” and “*Do not draw in background*” are *not* marked with a as a default setting, which means that these functions are active.

Do not display measurement info

If the mouse pointer is placed on a measured value within the graphics and rested there, a window with the current amplitude and time values will appear.

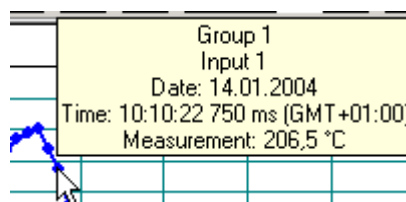

The window will disappear after a few seconds. If you deactivate the function () , the evaluation program has a reduced computing load and will thus become somewhat faster.

Do not draw in background

Standard procedure is that the picture is generated without being visible to the user and then suddenly switched into display (drawn in the background). If you select “*Do not draw in background*”, the graphics is displayed online on the screen. This means that you can observe how the curve profile is drawn. This view mode is somewhat faster than drawing in the background.

8 Evaluation - Graphics area

The difference between the two view modes will only become obvious if there is a vast amount of data to be processed.

Maximum number of measurements displayed per channel

You can set the number of the measurements to be displayed per channel by entering a number (from 10 to 10000) here. The higher the number, the more measurements will be shown in the graphics. The lower the number, the less measurements will be shown.



Caution: If the selected number of measurements is too small, the graphics will be displayed faster, but you will have to partially guess the curve profile for the actual measured values.

Properties → Display all measurements

Normally, only every nth measured value is displayed (depending on the zoom factor). This also applies to the print preview (page view) and the printout. You can force the display or printout of all measurements by means of the “Printout” and “Print preview” buttons.

Save diagram as bitmap

This function saves the current contents of the graphics area as a picture in bitmap format.


Save diagram as Jpeg

This function saves the current contents of the graphics area as a picture in JPEG format.

9 Evaluation - Table area

The table area is used to control the graphics and further functions. It is operated similar to spreadsheet programs. The area consists of several registers which can be switched into or out of display according to availability. The following is available as a maximum:

- Channels
- Periodic report
- Daily report
- Monthly report
- Annual report
- External report
- Events
- Audit trail
- Batches
- Signature for batches
- Signature for log-off
- PC signature for batches
- PC signature for time period
- Analog: Group...
- Digital: Group...

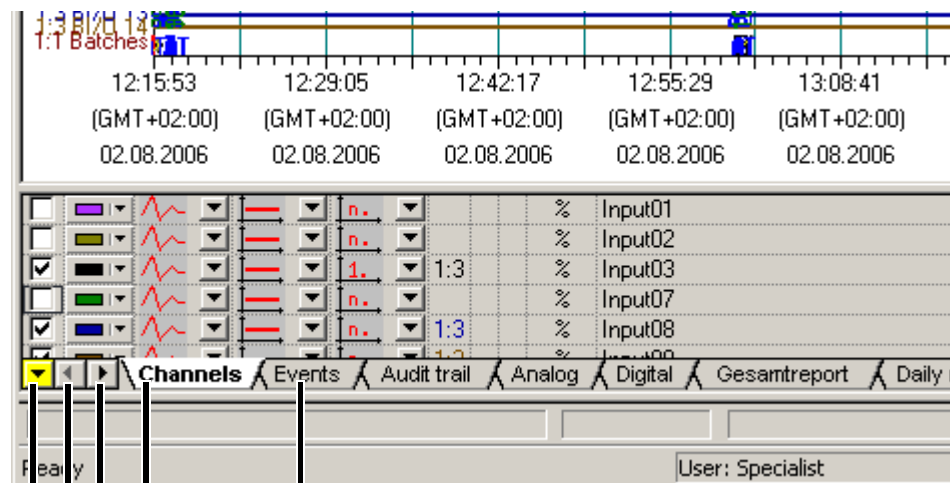

Click here to select the register as the active register

Active register

Click here to switch further registers into display (if available)

Click here to switch registers into and out of display or to switch columns in the registers into or out of display.

⇒ Chapter 9.1 "Switching registers into/out of display"


The right mouse button also has a special function in the table area. When you press the right mouse button, a dialog window opens with functions that vary according to the active register.


9 Evaluation - Table area

9.1 Switching registers into/out of display



Move the mouse pointer onto the field and press the left mouse button

- * Move the mouse pointer onto the  symbol and press the left mouse button.

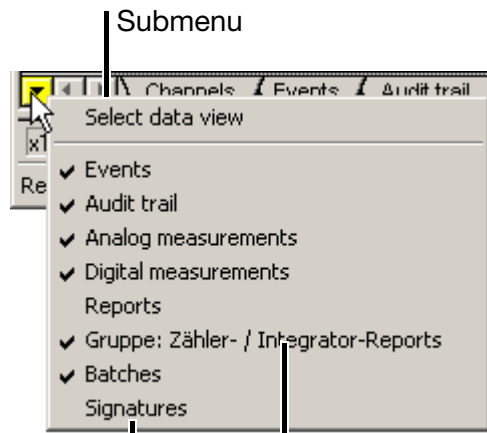

Submenu

Register is shown

Register is not shown

All registers that are shown are marked with a tick (☑). Clicking it with the left mouse button will change the display status.

If you click the entry **Select data view** with the left mouse button, a submenu will open, in which you can change the data view. This allows you, for instance, to alter the columns of a register.

Example of column



	Time		BI/O 09	BI/O 10	BI/O 11	BI/O 12
	Date dd.MM.yyyy	Time HH:mm:ss	Value	Value	Value	Value
1	02.08.2006	12:15:54	0	0	0	0
2	02.08.2006	12:15:55	0	0	0	0
3	02.08.2006	12:15:56	0	0	0	0

Example of register

9 Evaluation - Table area

Select data views

All changes are instantly shown in the current table area. Switching registers into and out of display will only become permanently effective when you click

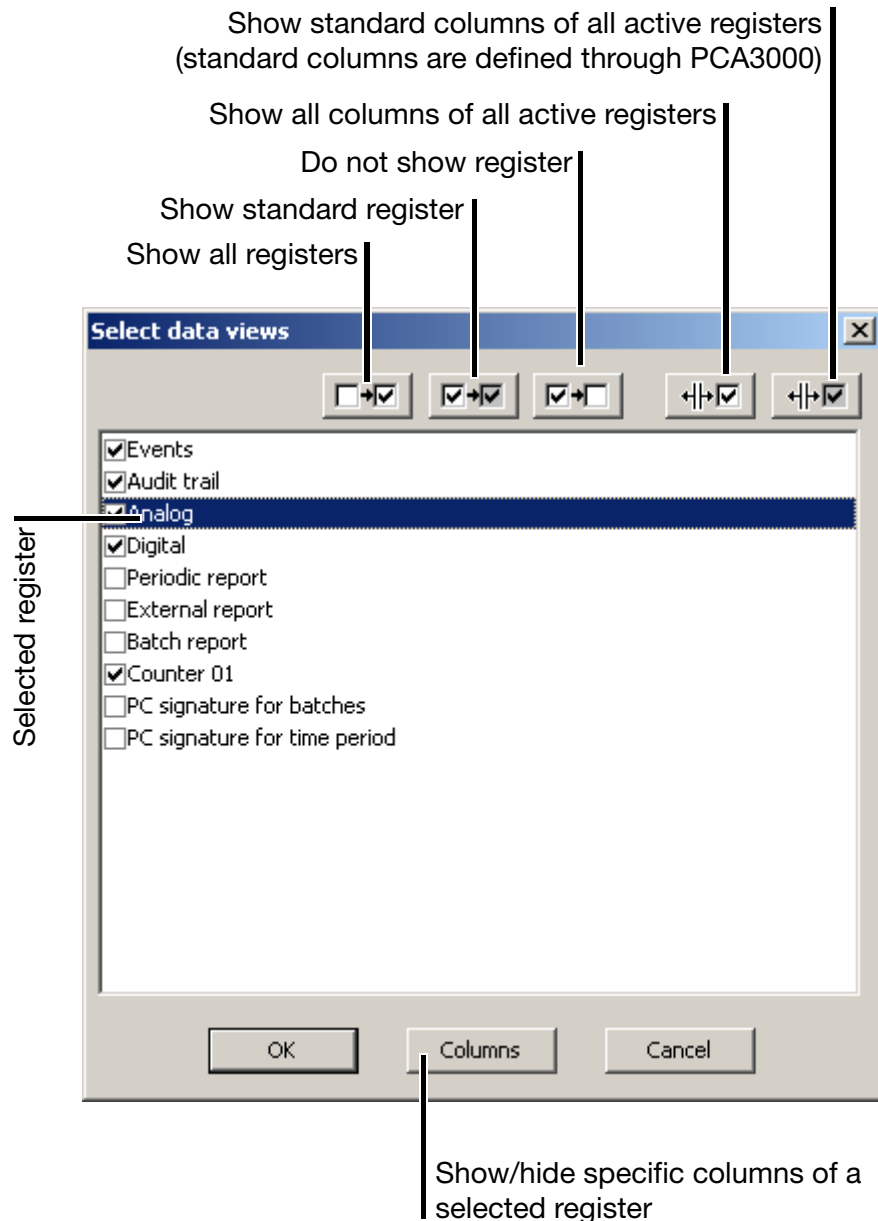

- * Press the left mouse button when the mouse pointer is positioned on a register name, in order to switch the register into/out of display, or activate one of the buttons that are available.



The submenu "Select data views" will also appear if you double-click (left mouse button) a register name, e. g. **Digital**.

9 Evaluation - Table area


Columns

By activating the **Columns** button, you can switch individual columns of an active register into or out of display.

Show standard columns of the active register

Show all columns of the active register

Name of the active register

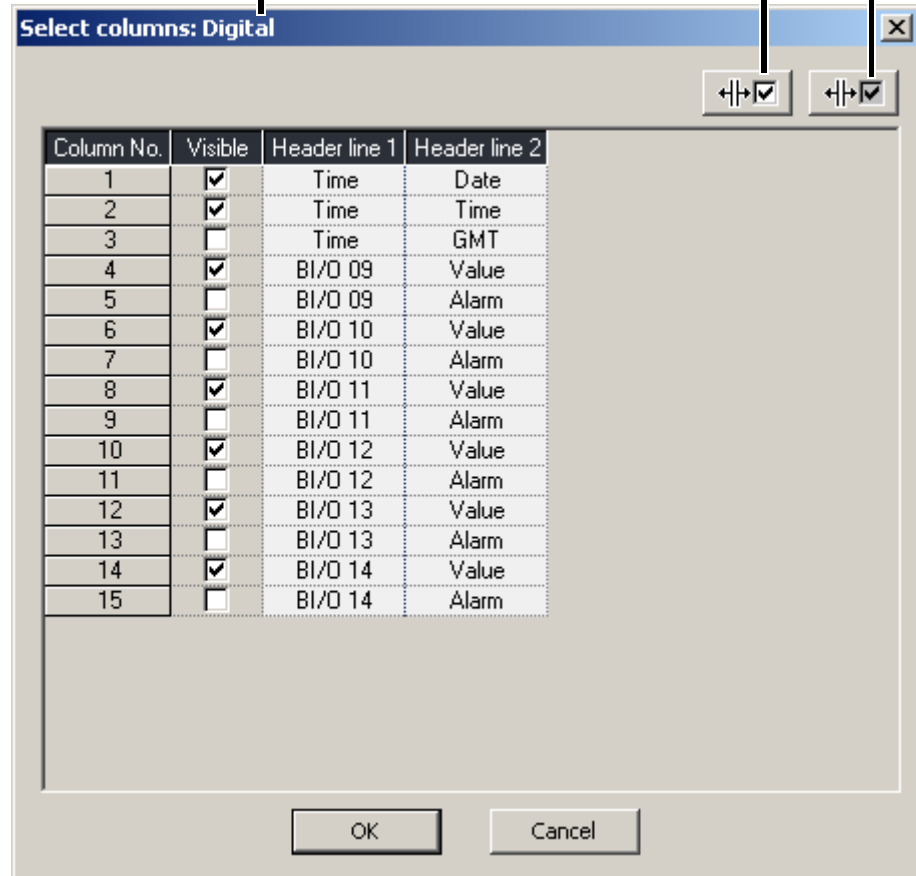

The submenu "Select columns" will also appear if you double-click (left mouse button) a column name, e. g. **BI/O 09**.

9.2 Channels

Labels in the screenshot:

- Display channel
- Channel color
- Line type
- Line width
- Y-axis type
- Ratio of displayed measurements to actual measurements.
- Display of channel unit
- Channel name
- Show additional columns in the table area (scroll columns).
- Group name

Channel	Unit	Group	Value
Input 1	°C	Group 1	-200
Input 2	°C	Group 1	-30
Input 3	°C	Group 1	10
Input 4	°C	Group 1	0
Input 5	°C	Group 1	50

Labels in the screenshot:

- Scaling start
- Scaling end
- Channel description
- Show additional rows in the table area (scroll rows).

Channel	Unit	Group	Value	Scaling Start	Scaling End	Channel Description
Input 1	°C	Group 1	-200,0	850,0	Input 1	
Input 2	°C	Group 1	-30,0	100,0	Input 2	
Input 3	°C	Group 1	10,0	100,0	Input 3	
Input 4	°C	Group 1	0,0	80,0	Input 4	
Input 5	°C	Group 1	50,0	100,0	Input 5	

9 Evaluation - Table area






9.2.1 The functions of the left mouse button

Display channel Each channel (analog, digital and messages) can be shown or hidden. Only channels that are marked with a are shown in the graphics area.




Channel color Here you can select the color in which the measured values and channel-specific data are displayed. The color affects both the graphics and the table area.

⇒ See “Colors” on page 77.



Line type (analog signals) The representation mode can be selected here (separately for each channel).



Line type (digital signals) The representation can also be altered for the digital signals.



Line type (messages) The representation can also be altered for the messages.



Line width Here you can select the line width for displaying the curve.

9 Evaluation - Table area

Y-axis type	<p>The axis type for a channel can be selected here. Available options are:</p> <ul style="list-style-type: none">- main Y-axis Please note that always only one channel can have a main Y-axis. The Y-axis can be found at the left edge of the screen.- auxiliary Y-axis The auxiliary Y-axes are to the right of the main Y-axis. Scaling of the data is adapted to the main Y axis.- no Y-axis No Y-axis is displayed for the selected channel.
--------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

9.2.2 Displays (cannot be altered directly)

Ratio of displayed measurements ...	<p>The current display factor is shown here. The factor changes if the measurements are zoomed.</p> <p>Example: Factor = 1:3 --> every third measurement is displayed.</p> <p>The parameter "Maximum number of measurements displayed per channel" will affect the factor.</p> <p>⇒ See "Maximum number of measurements displayed per channel" on page 40.</p>
Display for channel unit	Shows the unit of the channel that has been configured on the device.
Channel name	Shows the channel name that has been configured on the device.
Group name	Shows the group name that has been configured on the device.
Scaling start	Shows the scaling start that has been configured on the device.
Scaling end	Shows the scaling start that has been configured on the device.
Channel description	Shows the channel description that has been configured on the device.

9 Evaluation - Table area

9.2.3 The functions of the right mouse button

In the “Channels” register, the right mouse button is only used in connection with printing the displayed measurement curves.

Further information on the “Printing” function can be found in Chapter 9.11 “Printing”.

9.3 Report

	Time period							Minimum			
	From			To				Duration HH:mm:ss	Date	Time	GM
	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	dd.MM.yyy y		HH:mm:ss	HH:mm	
1	14.01.2004	10:03:44	+01:00	14.01.2004	11:00:00	+01:00	00:56:06	14.01.2004	10:10:58	+01:00	
2	14.01.2004	11:00:00	+01:00	14.01.2004	13:00:00	+01:00	02:00:00	14.01.2004	12:23:16	+01:00	
3	14.01.2004	13:00:00	+01:00	14.01.2004	15:00:00	+01:00	02:00:00	14.01.2004	13:23:14	+01:00	
4	14.01.2004	15:00:00	+01:00	14.01.2004	17:00:00	+01:00	02:00:01	14.01.2004	15:03:05	+01:00	

Channels \ Periodic report External report

xt: 14.01.2004 12:42:31 (GMT+01:00) yt: -300,0 °C

Ready User: Admin Password validity: indefinitely

The different registers for the report (statistics) are:

- Periodic report
- Daily report
- Monthly report
- Annual report
- External report


The individual reports that have been logged (including period, minimum, maximum and average values) are shown for all channels

9.3.1 The functions of the left mouse button

The left mouse button can be used to alter the column width and row height of the individual entries within the report registers.

Alter column width

- * Position mouse between two columns



- * Keeping the left mouse button pressed, alter column width by dragging with the mouse
- * Release the mouse button

Alter row height

- * Position mouse between two rows

1	09.09.2003
2	09.09.2003

- * Keeping the left mouse button pressed, alter row height by dragging with the mouse
- * Release the mouse button

9 Evaluation - Table area

Column width
Row height



Please note that a column or row can be made so small that it is no longer visible.

If you want to make it visible again, please proceed as described below. In this example, it is assumed that in the register “Analog: Group 1”, the column for the measurements on channel 1 has disappeared as a result of having been shrunk.

GMT	Input 2
HH:mm	°C
+01:00	25,8

- * Position the mouse pointer in the column to the right of the missing one (in this example: channel 2).

GMT	Input 2
HH:mm	↓ °C
+01:00	25,8

- * Move the mouse pointer to the left until it looks as shown below.

GMT	Input 2
HH:mm	↔ °C
+01:00	25,8

If the mouse pointer looks like this, you have moved it slightly too far.

GMT	Input 2
HH:mm	↔+ °C
+01:00	25,8

- * Press the left mouse button and open out the missing column out (drag mouse to the right).
- * If you now let go of the mouse button, the column will be visible again.

GMT	Input 1	Input 2	In
HH:mm	°C	°C	
+01:00	100,0	25,8	

Mark section

In addition, the left mouse button can be used to mark a section. These marked sections can be exported in a text format via the “Export” function by using the right mouse button.

- * Position mouse in an entry
- * Keeping the left mouse button pressed down, select the section by dragging with the mouse
- * Release the mouse button

9 Evaluation - Table area

Mark column * Position the mouse in the column header

The diagram shows a table with two columns. The first column has a header 'Value °C' and a data cell 'n'. The second column has a header 'Date dd.MM.yyy' and a data cell 'y'. A mouse cursor is positioned over the 'Input 1' header, which is located above the 'Date' header.

* Press the left mouse button


Mark row * Position the mouse in the left column of the row (→ 1)

* Press the left mouse button

Additional keys With the help of the Shift key and the left mouse button you can mark a section covering several rows or columns. The Ctrl key and the left mouse button can be used to mark additional rows /columns.

9.3.2 The functions of the right mouse button

If you press the right mouse button (mouse pointer must be within the table area), you will see the following dialog window.

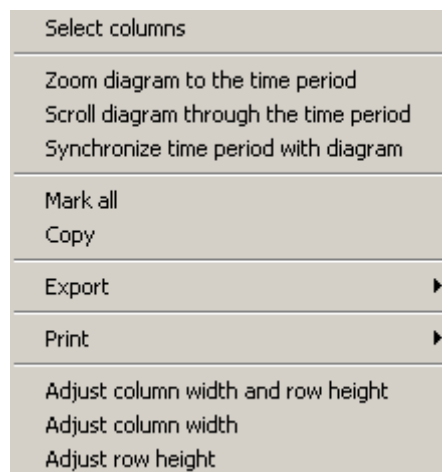

Select columns Using this function, individual columns of the active table can be shown or hidden.

⇒ “Columns” on page 44

Zoom diagram to time period The measurements of the selected report are zoomed in the diagram to the next displayable period and are graphically presented.

Scroll diagram to time period If the start time of the report is not within the visible time period, for example after zooming, then “Scroll time period” is used to shift the curves so that the start time (or the next possible one) is in line with the left window border.

Synchronize time period to diagram The entry that matches the displayed measurements is searched for in the table area and captured. The time shown at the left window border is decisive here.

9 Evaluation - Table area

Mark all	All table data are marked.
Copy	The data that are marked are copied to the Windows clipboard and can thus be imported directly into spreadsheet programs, for example (EXCEL or similar).
Export	Using the “Export” function, you can save data in text format (*.txt) or HTML format (*.htm) and subsequently process them. Measurements are always exported row by row. If a column is marked, the measurements of the other columns are also exported. ⇒ Chapter 9.12 “Data export”
Print	⇒ Chapter 9.11 “Printing”
Adjust column width and row height	The column width and row height - starting from the current cell - are automatically reset to the initial width and height.
Adjust column width	The column width for the current column is automatically reset to the initial width.
Adjust row height	The row height of the current row is automatically reset to the initial height.

9.4 Events

	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Event	Status
1	14.01.2004	10:03:48	+01:00	New configuration	
2	14.01.2004	17:08:40	+01:00	Power off	
3	15.01.2004	07:50:00	+01:00	Power on	
4	15.01.2004	09:03:25	+01:00	Gr1 Channel1 High alarm	ON

9.4.1 The functions of the left mouse button

The column width and row height of the individual entries can be altered within the event register by using the left mouse button.


The left mouse button is also used to mark a section. These marked sections can be exported in text format (*.txt) or HTML format (*.htm) through the “Export” function by pressing the right mouse button.

⇒ Chapter 9.12 “Data export”

Further information on altering the column width and row height, as well as marking a section, can be taken from Chapter 9.3 “Report”.

9.4.2 The functions of the right mouse button

If you press the right mouse button (the mouse pointer must be within the table area), the following dialog window open.

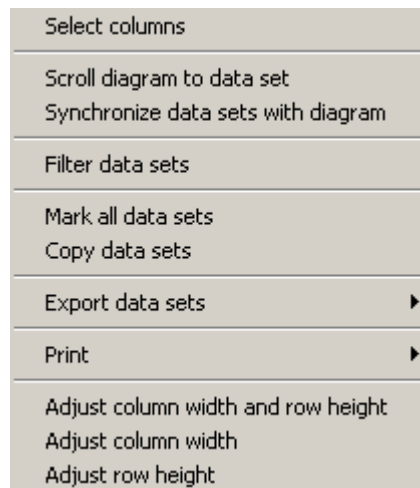

Select columns Using this function, individual columns of the active table can be shown or hidden.

⇒ “Columns” on page 44

9 Evaluation - Table area

Scroll diagram to data set

If the time for the event is not within the visible area of the diagram, for instance after zooming, then “Scroll data set” can be used to shift the curves so that the time (or the next possible one) is in line with the left window border.

Synchronize data sets with diagram


The entry that matches the displayed measurements is searched for in the table area and captured. The time shown at the left window border of the diagram is decisive here.

Filter data sets

“Filter data sets” serves to reduce the list of displayed events.

If, for example, the “System messages” field is inactivated () , the messages “New configuration”, “Power ON” and “Power OFF”, among others, will no longer be shown.

The display in the header informs you that the current display is a filtered selection.


	Date
==	dd.MM.yyyy
4	15.01.2004

The individual filter parameters are OR-linked, and additionally AND-linked with the full-text search.

Filtering is reset when

- the graphics evaluation is closed or
- all criteria have been marked with a tick.

Example of a filter setting:

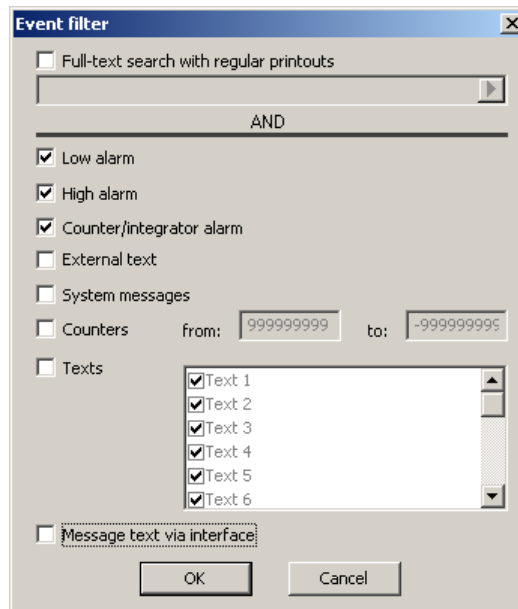

Only the event types “Low alarm”, “High alarm” or “Counter/integrator alarm” are displayed.

Mark all data sets

All table data are marked.

9 Evaluation - Table area

Copy data sets	The data that are marked are copied to the Windows clipboard and can thus be imported directly into spreadsheet programs (EXCEL or similar).
Export data sets	<p>Using this function, you can save data in text format (*.txt) or in HTML format (*.htm) and subsequently process them.</p> <p>Measurements are always exported row by row. If a column is marked, the measurements of the other columns are also exported.</p> <p>⇒ Chapter 9.12 “Data export”</p>
Print	Further information on the “Printing” function can be found in Chapter 9.11 “Printing”.
Adjust column width and row height	The column width and row height - starting from the current cell - are automatically reset to the initial width and height.
Adjust column width	The column width for the current column is automatically reset to the initial width.
Adjust row height	The row height of the current row is automatically reset to the initial height.

9 Evaluation - Table area

9.5 Audit trail

The device audit trail entries are stored in this register. Audit trail entries that refer to the PC software components can be evaluated through the PC Audit Trail Manager software.

	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	No.	User ID	Event	Description
1	14.01.2004	10:03:55	+01:00	7	Master	NEW CONFIGURATION	(Interface).
2	14.01.2004	10:14:15	+01:00	8	Master	Transmission process data: start	... Interface.
3	14.01.2004	10:14:47	+01:00	9	Master	Transmission process data: end	... Interface.
4	14.01.2004	10:16:57	+01:00	10	Master	Login	(Key).
5	14.01.2004	10:17:03	+01:00	11	Master	CF card plugged in	

Navigation: Daily report | Events | **Audit trail** | Batches | P

Status: x1: 14.01.2004 10:44:09 (GMT+01:00) | y1: 17.3 °C

Ready | User: Admin Password validity: indefinitely

9.5.1 The functions of the left mouse button

The column width and row height of the individual entries can be altered within the audit trail register by using the left mouse button.


The left mouse button is also used to mark a section. These marked sections can be exported in text format (*.txt) or HTML format (*.htm) through the “Export” function by pressing the right mouse button.

⇒ Chapter 9.12 “Data export”

Further information on altering the column width and row height, as well as marking a section, can be taken from Chapter 9.3 “Report”.

9.5.2 The functions of the right mouse button

If you press the right mouse button (the mouse pointer must be within the table area), you will see the following dialog window.

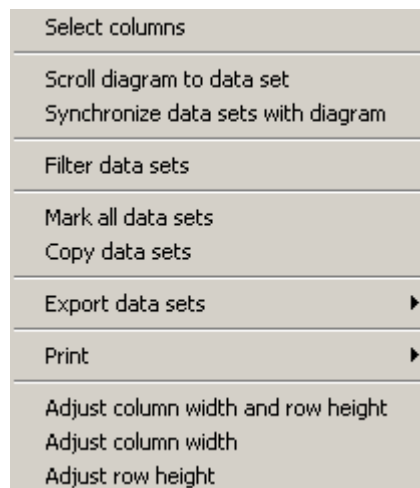


The operation largely corresponds to that described in Chapter 9.4 “Events”, with the “Filter data sets” function deviating from it.

9 Evaluation - Table area

Filter data sets The list of displayed audit trail entries can be reduced by using the “Filter data sets” function.

The display in the header informs you that the current display is a filtered selection.

	Date
	dd.MM.yyyy
4	15.01.2004

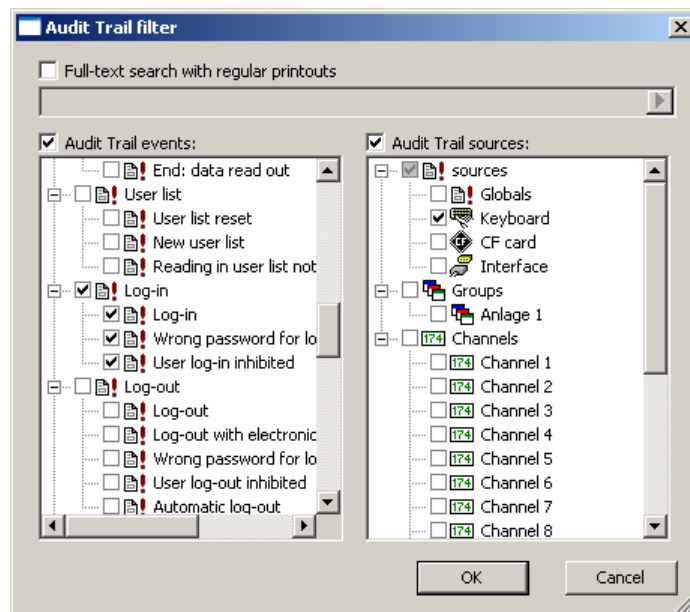

The audit trail entries can be filtered by means of two different filter types, which can be activated independently of one another.

Filter types:


- audit trail events
- audit trail sources

If both filter types are activated, they are AND-linked, which means that the audit trail event is only displayed if it is listed both in the “audit trail events” filter and the “audit trail sources” filter.

The individual filter conditions for a filter type are OR-linked, and additionally AND-linked with the full-text search.

Filtering is reset if


- the graphics evaluation is closed or
- “audit trail events”, “audit trail sources” and full-text search have not been activated.

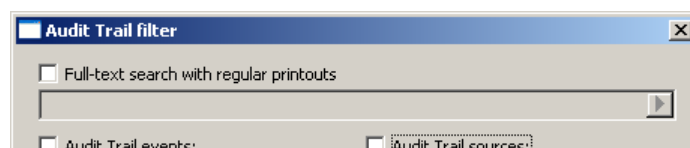

9 Evaluation - Table area

9.6 Batches

This register lists all the recorded batch documentation.

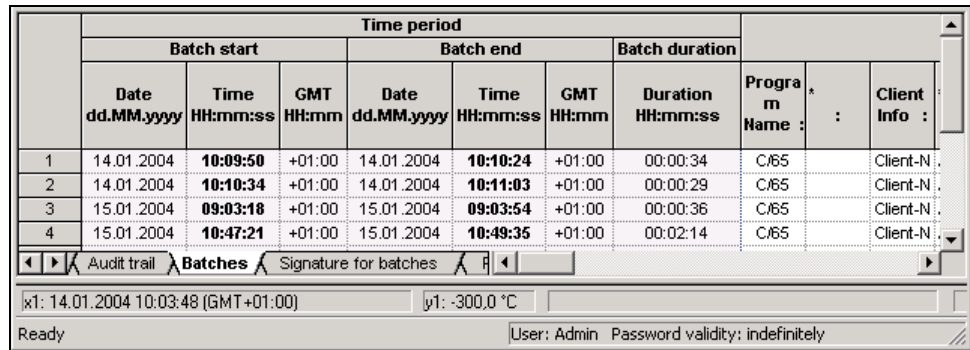

	Time period							Program Name	Client Info
	Batch start			Batch end			Batch duration		
	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Duration HH:mm:ss		
1	14.01.2004	10:09:50	+01:00	14.01.2004	10:10:24	+01:00	00:00:34	C65	Client-N
2	14.01.2004	10:10:34	+01:00	14.01.2004	10:11:03	+01:00	00:00:29	C65	Client-N
3	15.01.2004	09:03:18	+01:00	15.01.2004	09:03:54	+01:00	00:00:36	C65	Client-N
4	15.01.2004	10:47:21	+01:00	15.01.2004	10:49:35	+01:00	00:02:14	C65	Client-N

9.6.1 The functions of the left mouse button

The column width and row height of the individual entries can be altered within the batch register by using the left mouse button.


The left mouse button is also used to mark a section. These marked sections can be exported in text format (*.txt) or HTML format (*.htm) through the “Export” function by pressing the right mouse button.

⇒ Chapter 9.12 “Data export”

Further information on altering the column width and row height, as well as marking a section, can be taken from Chapter 9.3 “Report”.

9.6.2 The functions of the right mouse button

If you press the right mouse button (the mouse pointer must be within the table area), you will see the following dialog window.

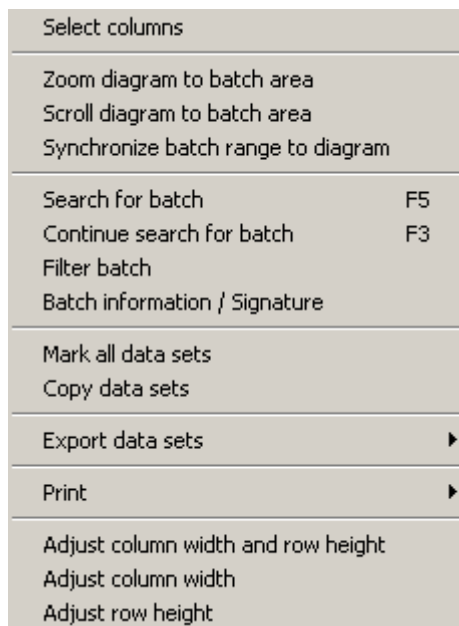

Select columns	
Zoom diagram to batch area	
Scroll diagram to batch area	
Synchronize batch range to diagram	
Search for batch	F5
Continue search for batch	F3
Filter batch	
Batch information / Signature	
Mark all data sets	
Copy data sets	
Export data sets	▶
Print	▶
Adjust column width and row height	
Adjust column width	
Adjust row height	

9 Evaluation - Table area

Select columns Using this function, individual columns of the active table can be switched into or out of display.

⇒ “Columns” on page 44

Zoom diagram to batch period (batch range) The measurements of the selected batch are zoomed to the next displayable period and are graphically presented.

Scroll diagram to batch period (batch range) If the start time of the batch data is not within the visible time period, for example after zooming, then “Scroll batch period” is used to shift the curves so that the start time (or the next possible one) is in line with the left window border.

Synchronize batch period (batch range) to diagram The entry that matches the displayed measurements is searched for in the table area and captured. The time shown at the left window border is decisive here.

Search batch Specific batch documentation can be found by means of the “Search for batch” function. The search can be made easier by applying different criteria. Without the specification of criteria, all batch documentation is searched for.

Before you can enter a search criterion, it must be activated. Active search criteria can be recognized by the . All activated search criteria are AND-linked.

Continue search for batch The “Continue search for batch” function, which is only available if the “Search for batch” function has been performed, repeats a defined search for a specific batch documentation.

Filter batch “Filter batch” serves to reduce the list of available batches.

Before you can enter a filter, it must be activated (.

The display in the header informs you that the current display is a filtered selection.



		
	Batch start	
	Date	Time

The batch filters refer to the individual columns in the batch list, i.e. one filter criterion can be defined for each column. A batch will only be displayed when all active column filter criteria have been fulfilled.

All active column filters and the full-text search are AND-linked.

9 Evaluation - Table area

The columns are divided into a batch data section and a signature data section. A column criterion is true if the text entered appears in the column data.

Criteria	Data	Operator
<input type="checkbox"/> Full-text search with regular printouts		
<input type="checkbox"/> Program name	C/65	
<input checked="" type="checkbox"/> Customer info	No. 00342 15	
<input type="checkbox"/> Batch name		
<input checked="" type="checkbox"/> Batch number	4	
<input type="checkbox"/> Batch start		
<input type="checkbox"/> Batch end		
<input type="checkbox"/> Batch duration		
<input type="checkbox"/> Recipe		
<input type="checkbox"/> Batch start	02.08.2006 09:56:00 (GMT+02:00)	>=
<input type="checkbox"/> Batch end	02.08.2006 09:59:17 (GMT+02:00)	>=
<input type="checkbox"/> Batch duration		>=

In the example shown above, the three batch criteria “Batch start”, “Batch end” and “Batch duration” occur twice. Those listed first (above the “Recipe data” criterion) have been configured by the user. Those that follow (below the “Recipe data” criterion) are generated by the recorder through the device software.

Filtering is reset when

- the graphical evaluation is closed or
- none of the criteria has been activated.

Batch information/signature


This function serves to display the batch information and, if available, also the signature for the selected batch. In addition, you can view the entered recipe data.

If a batch has not been signed yet, you can make up for it now by using this function. Executing a signature in this way will be recorded in the register “PC signature for batches”.

- * Using the left mouse button, double-click on the field with the recipe data - the data will now be shown in a separate window and can be viewed more easily.

Recipe data cannot be altered. They can be transmitted to the recorder (using the Setup program) for a batch that has not yet been completed. After the end of the batch, the recipe data will be automatically deleted, being available only for batch documentation.

9 Evaluation - Table area

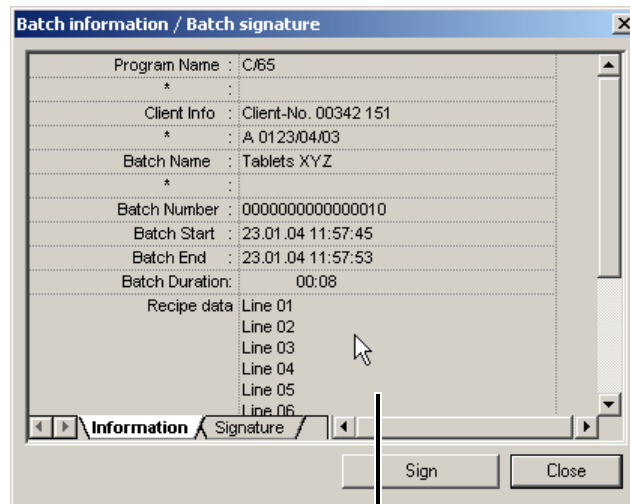

Click here to view
the recipe data

Mark all data sets

All table data are marked.

Copy data sets

The data that are marked are copied to the Windows clipboard and can thus be imported directly into spreadsheet programs (EXCEL or similar).

Export data sets

Using the “Export” function, you can save data in text format (*.txt) or HTML format (*.htm) and subsequently process them. Measurements are always exported row by row. If a column is marked, the measurements of the other columns are also exported.

⇒ Chapter 9.12 “Data export”

Print

⇒ Chapter 9.11 “Printing”

Adjust column width and row height

The column width and row height - starting from the current cell - are automatically reset to the initial width and height.

Adjust column width

The column width for the current column is automatically reset to the initial width.

Adjust row height

The row height of the current row is automatically reset to the initial height.

9 Evaluation - Table area

9.7 Batch signature (PC signature for batches)

This register lists the recorded batch signatures.

There are two registers:

- signature for batch (signed on the device) and
- PC signature for batches (signed within the PCA3000).

Both have identical functions.

	Time period						No.	Time of signature		
	From			To				Date	Time	GMT
	dd.MM.yyyy	HH:mm:ss	HH:mm	dd.MM.yyyy	HH:mm:ss	HH:mm		dd.MM.yyyy	HH:mm:ss	HH:mm
1	15.01.2004	11:50:51	+01:00	15.01.2004	11:51:27	+01:00	000000 00-000	15.01.2004	11:52:40	+01:00
2	15.01.2004	11:52:55	+01:00	15.01.2004	11:53:21	+01:00	000000	15.01.2004	11:53:34	+01:00

Batches
 Signature for batches
 PC signature for batches

x1: 14.01.2004 10:03:48 (GMT+01:00)
y1: -300.0 °C

Ready User: Admin Password validity: indefinitely

9.7.1 The functions of the left mouse button

The column width and row height of the individual entries can be altered within the batch register by using the left mouse button.

The left mouse button is also used to mark a section. These marked sections can be exported in text format (*.txt) or HTML format (*.htm) through the "Export" function by pressing the right mouse button.

⇒ Chapter 9.12 "Data export"

Further information on altering the column width and row height, as well as marking a section, can be taken from Chapter 9.3 "Report".

9.7.2 The functions of the right mouse button

If you press the right mouse button (the mouse pointer must be within the table area), the following dialog window opens.


Select columns
Zoom diagram to the time period
Scroll diagram through the time period
Synchronize time period with diagram
Filter signatures
Mark all data sets
Copy data sets
Export data sets ▶
Print ▶
Adjust column width and row height
Adjust column width
Adjust row height

9 Evaluation - Table area

The operation corresponds to that described in Chapter 9.3 “Report”. In addition, there are:

Filter signatures “Filter signatures” serves to reduce the list of displayed signatures. Only those signatures will be shown for which matching selection criteria have been specified.

The display in the header informs you that the current display is a filtered selection.

	
	Date dd.MM.yyyy
1	15.01.2004

All active filter criteria and the full-text search are AND-linked.

9 Evaluation - Table area

9.8 Log-off signature (PC signature for time period)

This register lists additional signatures.

There are two registers:

- Log-off signature (log-off on device) and
- PC signature for time period (signed within PCA3000 with the function *Edit → Sign time period*).

Both have identical functions.

	Time period						No.	Time of signature		
	From			To				Date	Time	GMT
	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm		dd.MM.yyyy	HH:mm:ss	HH:mm
1	15.01.2004	09:05:25	+01:00	15.01.2004	12:21:10	+01:00	000000 04-000	15.01.2004	12:21:10	+01:00

Signature for batches Signature for logg-off

xl: 14.01.2004 13:22:32 (GMT+01:00) yl: -300,0 °C

Ready User: Admin Password validity: indefinitely

9.8.1 The functions of the left mouse button

The column width and row height of the individual entries can be altered within the batch register by using the left mouse button.

The left mouse button is also used to mark a section. These marked sections can be exported in text format (*.txt) or HTML format (*.htm) through the “Export” function by pressing the right mouse button.

⇒ Chapter 9.12 “Data export”

Further information on altering the column width and row height, as well as marking a section, can be taken from Chapter 9.3 “Report”.

9.8.2 The functions of the right mouse button

After pressing the right mouse button (the mouse pointer must be within the table area), you will see the same dialog window as described in Chapter 9.7 “Batch signature (PC signature for batches)”.

9.9 Analog: Group...

This register lists the measurements of the analog inputs.

	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Input 1 °C	Input 2 °C	Input 3 °C	Input 4 °C	Input 5 °C	Input 6 °C
1	14.01.2004	10:03:55	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<
2	14.01.2004	10:03:56	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
3	14.01.2004	10:03:57	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
4	14.01.2004	10:03:58	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<

Analog: Group 1 Digital: Group 1

x1: 14.01.2004 10:03:48 (GMT+01:00) y1: 223,6 °C

Ready User: Admin Password validity: indefinitely

<<<< = underrange >>>> = overrange

9.9.1 The functions of the left mouse button

The column width and row height of the individual entries can be altered within the register for the analog data by using the left mouse button.


The left mouse button is also used to mark a section. These marked sections can be exported in text format (*.txt) or HTML format (*.htm) through the "Export" function by pressing the right mouse button.

⇒ Chapter 9.12 "Data export"

Further information on altering the column width and row height, as well as marking a section, can be taken from Chapter 9.3 "Report".

9.9.2 The functions of the right mouse button

If you press the right mouse button (the mouse pointer must be within the table area), you will see the following dialog window.

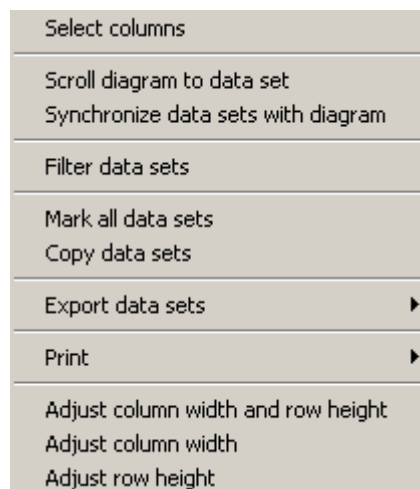


The operation corresponds to that described in Chapter 9.4 "Events".

9 Evaluation - Table area

9.10 Digital: Group...

This register lists the measurements of the digital inputs.

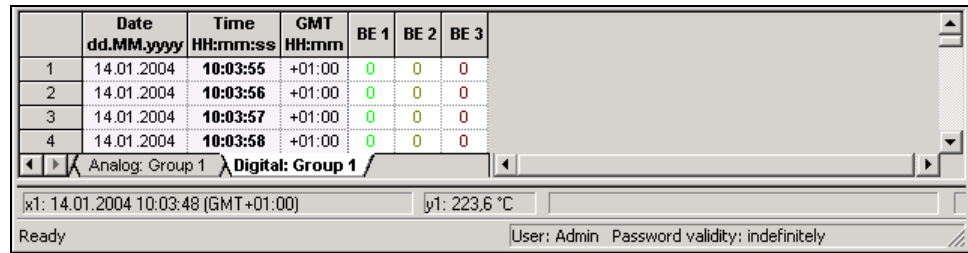

The screenshot shows a software interface with a table of digital input measurements. The table has columns for Date, Time, GMT, and three digital input channels (BE 1, BE 2, BE 3). Below the table, there are status indicators for the current date and time, and the user's login information.

	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	BE 1	BE 2	BE 3
1	14.01.2004	10:03:55	+01:00	0	0	0
2	14.01.2004	10:03:56	+01:00	0	0	0
3	14.01.2004	10:03:57	+01:00	0	0	0
4	14.01.2004	10:03:58	+01:00	0	0	0

Navigation: Analog: Group 1 / Digital: Group 1

Status: x1: 14.01.2004 10:03:48 (GMT+01:00) y1: 223,6 °C

Ready User: Admin Password validity: indefinitely


It provides the same functions and options as the register for the analog measurements.

⇒ Chapter 9.9 “Analog: Group...”

9 Evaluation - Table area

9.11 Printing

After calling up the “Print” function, the following dialog window opens.



Print preview

The “Print preview” function will give you a view of the page as it will be printed. Depending on the active register, further selection options will appear before the print preview, where you can choose which data are to be displayed.

Print


Initiates the printing procedure. Please note that, in the case of a zoomed display, the printout may cover several pages.

Header / Footer

Headers/footers can be defined here. Any character strings and device-specific variables are available.

Cells for text and control elements.
You can apply a line break by entering Ctrl+Enter on the PC keyboard.

Select font type/size

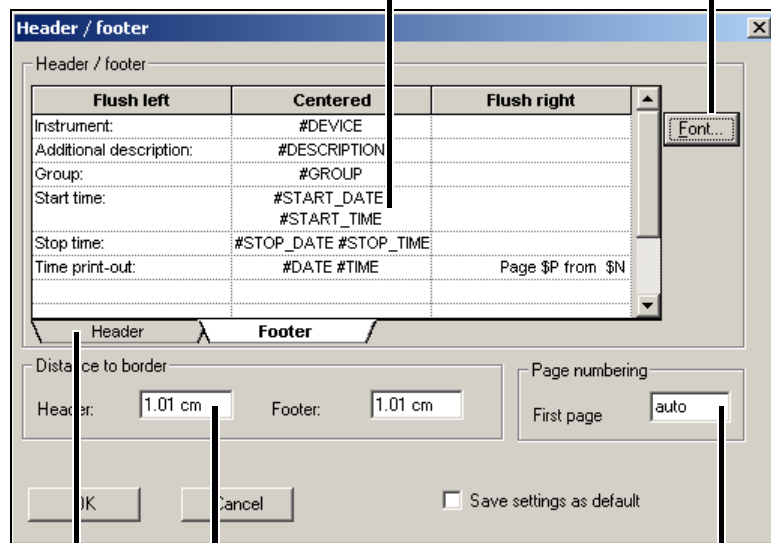

Predefine start page number

Set paper margin

Switch between header and footer.

Device-specific variables are preceded by a “\$” or a “#” sign.

The following device-specific variables are available:

9 Evaluation - Table area

#USER	Logged-in PC user
#NAME_USER	Name of logged-in PC user
\$P	Page number
\$N	Total page number
\$D	Print date/time
\$D{%d.%m.%y}	Print date (without time)
\$F	Name of evaluation
\$A	Program name
\$R	Register name
#DEVICE	Device name
#FABNR	Device production No.
#GROUP	Group name
#DESCRIPTION	Supplementary description
#TIME	Current time
#DATE	Current date
#START_TIME	Start time of evaluation
#STOP_TIME	End time of evaluation
#START_DATE	Start date of evaluation
#STOP_DATE	End date of evaluation
#EINH_TIME	Time of formatting
#EINH_DATE	Date of formatting


Within the “Batches” register additionally:

#CHARGE_1_HEADER ... #CHARGE_30_HEADER	Designation of the batch data (column designation)
#CHARGE_1_VALUE ... #CHARGE_30_VALUE	Batch data (column value)

You can not only enter the device-specific variables directly, but also select them from a list.

9 Evaluation - Table area

- * Position the mouse pointer in that field in which you want to enter the parameter.
- * Press the right mouse button.
- * Position the mouse pointer on the required parameter and select it by using the left mouse button.

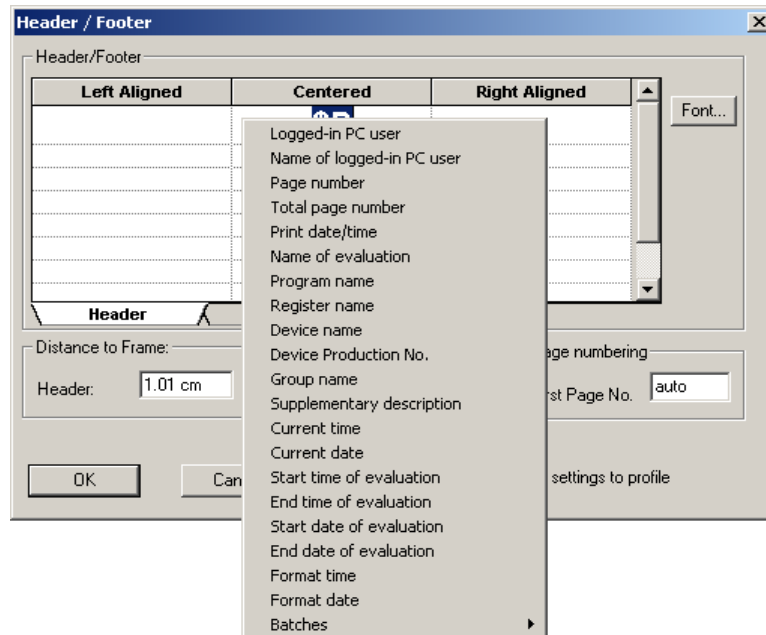

Set up page

The "Page setup" function offers additional functions for influencing the appearance of the printout.

Printer setup


The "Printer setup" function opens a Windows dialog window in which, among others, you can select the paper size and orientation (portrait or landscape format).

9 Evaluation - Table area

9.12 Data export

The data export to EXCEL¹ via a text file will be explained more fully in this chapter by giving an example.

Export through text file

- * Open the evaluation through the *Archive* → *Open* menu, or by activating the  button.
- * Activate the register *Analog: Group 1* by clicking on it with the left mouse button.

	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Input 1 °C	Input 2 °C	Input 3 °C	Input 4 °C	Input 5 °C	Input 6 °C
1	14.01.2004	10:03:55	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<
2	14.01.2004	10:03:56	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
3	14.01.2004	10:03:57	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
4	14.01.2004	10:03:58	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<
5	14.01.2004	10:03:59	+01:00	99,9	25,8	10,0	8,0	50,0	10,0
6	14.01.2004	10:04:00	+01:00	99,9	25,8	10,0	8,0	50,0	10,0

Analog: Group 1 / Digital: Group 1

xl: 14.01.2004 10:03:48 (GMT+01:00) yl: -83,1 °C

Ready User: Admin Password validity: indefinitely

Row numbering

- * Mark the section by moving the mouse downwards over the row numbering (keep left mouse button pressed). When you have marked the required section, release the mouse button.


	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Input 1 °C	Input 2 °C	Input 3 °C	Input 4 °C	Input 5 °C	Input 6 °C
1	14.01.2004	10:03:55	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<
2	14.01.2004	10:03:56	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
3	14.01.2004	10:03:57	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
4	14.01.2004	10:03:58	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<
5	14.01.2004	10:03:59	+01:00	99,9	25,8	10,0	8,0	50,0	10,0
6	14.01.2004	10:04:00	+01:00	99,9	25,8	10,0	8,0	50,0	10,0

Analog: Group 1 / Digital: Group 1

xl: 14.01.2004 10:03:48 (GMT+01:00) yl: -83,1 °C

Ready User: Admin Password validity: indefinitely

- * Press the right mouse button and call up *Export data sets* followed by *Text file (*.txt)*.
- * In the dialog below, choose *Selected data sets* and *Comma* as the delimiter. Confirm the selection with OK.

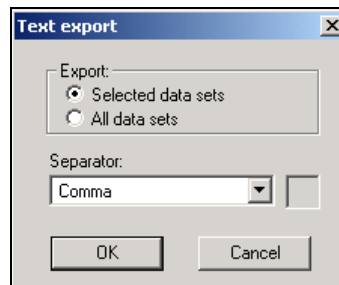

- * In the dialog window that opens now, you can select the path and enter the file name under which the text file (ASCII file) is saved.

When it has been saved successfully, the file can be read into EXCEL.

1. EXCEL is a registered trademark of Microsoft Corporation

9 Evaluation - Table area

Processing in EXCEL

- * Start EXCEL (e.g. EXCEL 97).
- * Select the *Open* function in the *File* menu.
- * Switch the file type over to *Text files*.
- * Open the file that has previously been created in PCA3000.


EXCEL will automatically start the Text Assistant for converting the data to the EXCEL format.


- * In the EXCEL Text Assistant step 1 of 3 is confirmed with “Continue”.
- * With step 2 of 3, the “Tab” delimiter has to be inactivated and “Comma” activated.
- * Close the Text Assistant with “Close”.

The text file data are now available for graphical display or for computation purposes.

Export via clipboard

Another possibility of importing data into EXCEL is provided (using the right mouse button) within the different tables of the evaluation program PCA.

- * Open the evaluation through the *Archive* → *Open* menu, or by activating the  button.
- * Activate the register *Analog: Group 1* by a click with the left mouse button.

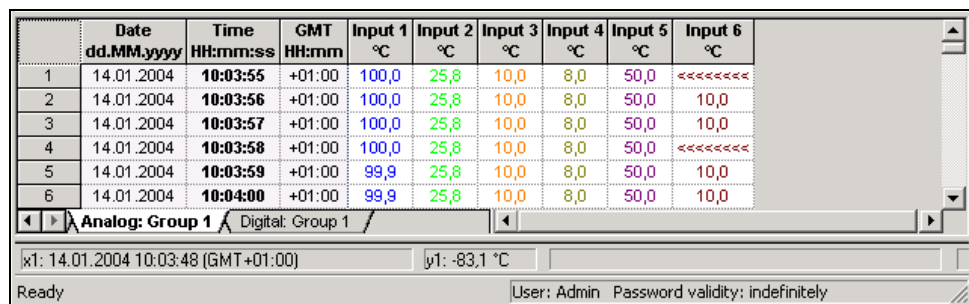

	Date dd.MM.yyyy	Time HH:mm:ss	GMT HH:mm	Input 1 °C	Input 2 °C	Input 3 °C	Input 4 °C	Input 5 °C	Input 6 °C
1	14.01.2004	10:03:55	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<
2	14.01.2004	10:03:56	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
3	14.01.2004	10:03:57	+01:00	100,0	25,8	10,0	8,0	50,0	10,0
4	14.01.2004	10:03:58	+01:00	100,0	25,8	10,0	8,0	50,0	<<<<<<<<
5	14.01.2004	10:03:59	+01:00	99,9	25,8	10,0	8,0	50,0	10,0
6	14.01.2004	10:04:00	+01:00	99,9	25,8	10,0	8,0	50,0	10,0

Analogue: Group 1 / Digital: Group 1

x1: 14.01.2004 10:03:48 (GMT+01:00) y1: -83,1 °C

Ready User: Admin Password validity: indefinitely

- * Mark a column by moving the mouse onto the column header (e.g. channel 1) and using the left mouse button.
- * Call up the “Copy data sets” function with the right mouse button. The data are now in the Windows clipboard.
- * Start up EXCEL, open a worksheet and insert the data in the worksheet by means of the EXCEL menu *Edit* → *Insert*.



When exporting via the clipboard, the data are directly available in a numerical format and need not be converted through the EXCEL Text Assistant.

9 Evaluation - Table area

10 Menu functions and toolbar

10.1 Archive

Open



This function displays measurement data from an archive graphically. How this is done has already been described in Chapter 6.3 “Opening the archive”.

After selecting the archive to be opened, you have to first select the group before the data can be displayed graphically. In addition to the device groups that are available (generated within the paperless recorder), PCA groups can be created and selected. They can be used to reorganize the device groups.

PCA groups
A click with the left mouse button will open the register for creating PCA groups.


Delete PCA group
Edit PCA group
Create PCA group


Device language
Display of the analog channels contained in the PCA groups
Display of the PCA groups created
Display of the digital channels contained in the PCA groups





With instruments featuring an integrated language management or several integrated languages, you can select the language and thus activate different channel names and descriptions.


10 Menu functions and toolbar

After activating the  button, you can create the “virtual” PCA groups.

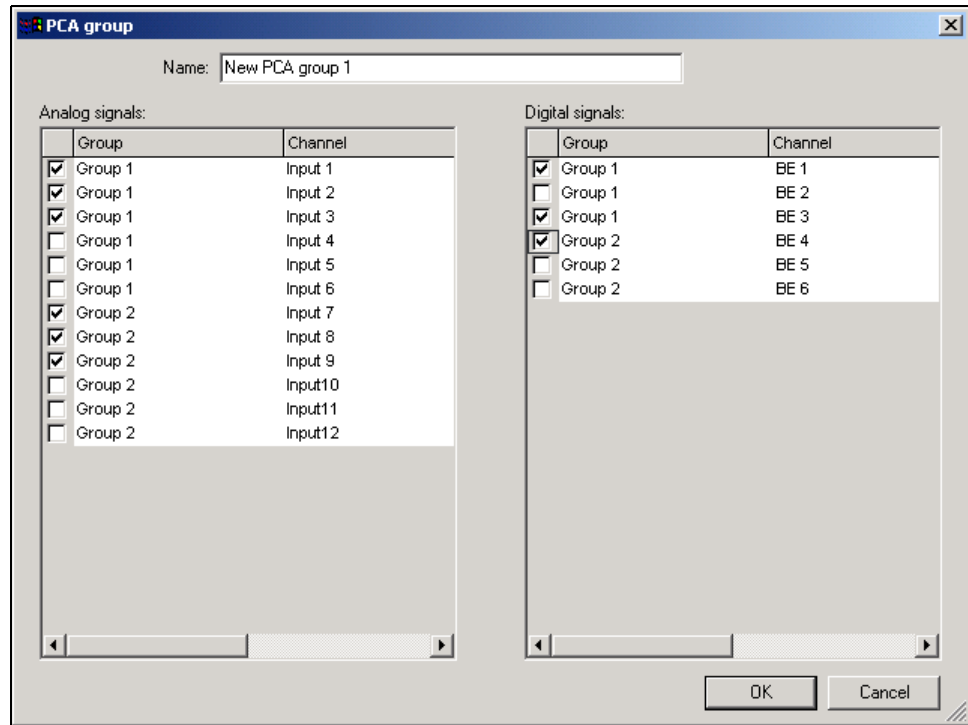

All activated channels are brought together in the PCA group after clicking

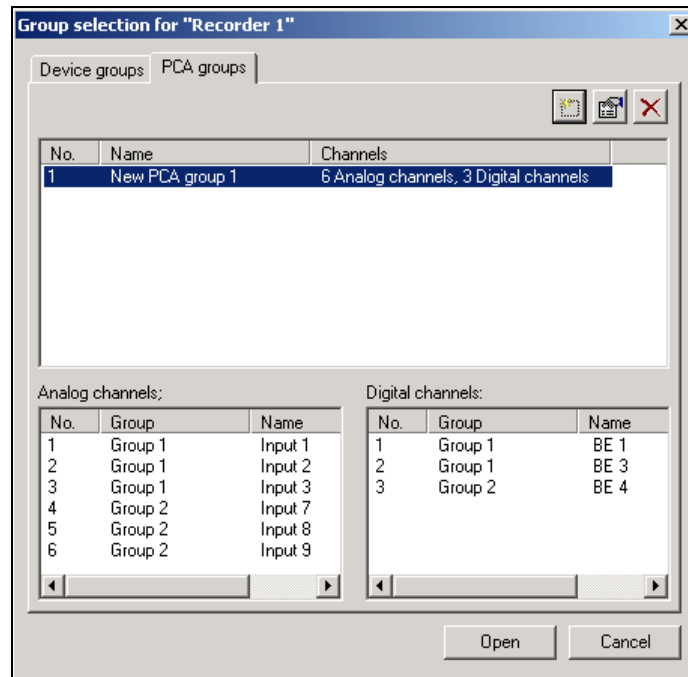

When you click , the data will be displayed graphically.

10 Menu functions and toolbar

Open batch



This function also displays measurement data from an archive graphically. Unlike the *Open* function, not all the data from an archive will be shown here, but only those of a specific batch.

Open electronic signature



This function also displays measurement data from an archive graphically. Unlike the *Open* function, not all the data from an archive will be shown here, but only those for which a signature has been executed.

Close

Closes a graphical display, but not the PCA3000 program.


Read in data



This function reads measurement data from the CompactFlash memory card into an archive. The procedure has already been described in Chapter 6.2 “Reading in data”.

All activated archives are read in. Position the mouse pointer on the selection of available archives and press the right mouse button. You now have further selection options for activating and deactivating archived files.

Select all files
Cancel selection
Reverse selection

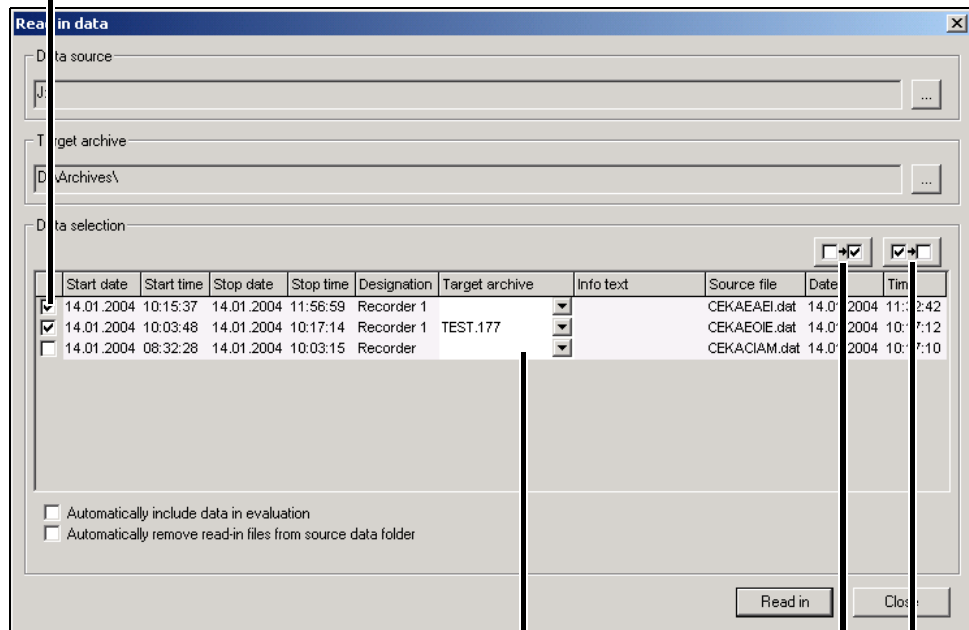

If you left-click on a file name, you can alter it. Specific archives can be saved to a separate file in this way.


Select all files
Cancel selection

This type of archiving is intended to achieve the simplest possible assignment between the CF data files and the archived files. When determining the target archive, the following sequence has to be observed:

- The device ID and the configuration ID of all data files in the “Folder for data source” path are determined. In each case, there is only one device ID for each device. Configuration IDs are provided for each reconfiguration

10 Menu functions and toolbar

(alteration of the setting) of any device.

- Search procedure 1:
In the “Folder for target archives” path, all existing archives are searched for a corresponding device and configuration ID, which will be determined. The files found are made available for selection in the “Target archive” field (click on ). The first archive that has been found will be automatically entered in the “Target archive” field.
- Search procedure 2:
The search procedure corresponds to the first search procedure, with the difference that only one archive with a corresponding device ID is searched for. The second search procedure will only be started if no archive has been found during the first one.
- If no corresponding archive was found during the two search procedures, the “Target archive” remains empty and you can enter an archive name by hand.
- An archive name that has been entered automatically can be manually overwritten.
- If a target archive field remains empty, there will be an archive name query during read-in.
- The “Folder for data source” and “Folder for target archive” settings will be backed up after the read-in and automatically entered when the function is called up next.

Save data



This function saves measurement data from one archive to a separate file. This file can be passed on, for example for examination purposes. The procedure has already been described in Chapter 6.4 “Backing up data”.

Save data as



This function saves measurement data from an archive into a separate file with additional protection options. This file can be passed on for checking purposes, for example. How this is done, has already been described in Chapter 6.4 “Backing up data”.

Print preview

This function serves to check the print result.

Printer setup

Here you can make alterations to the settings for your printer. When the program is started, the Windows default printer will always be set as the active printer.

Print



This function starts the print job.

Default settings

Here you can make alterations to the default settings for the program. The alterations will only take effect after a fresh start of the PCA3000 software.

General

In the “General” register you can select the language that the software has to use at the next program start.

10 Menu functions and toolbar

File deposit


In the “File deposit” register you can determine the standard (default) directories (paths) for the archive and evaluation directory.

⇒ Chapter 6.5 “Archive and evaluation directory”

Colors

In the “Colors” register, the color assignment of the individual channels within the graphics can be defined. You can define 12 colors. If more than 12 channels are visualized, as a result of external channels or logic inputs, for example, the color sequence will be repeated. You can still alter the colors within the graphics later on.

⇒ Chapter 9.2 “Channels”

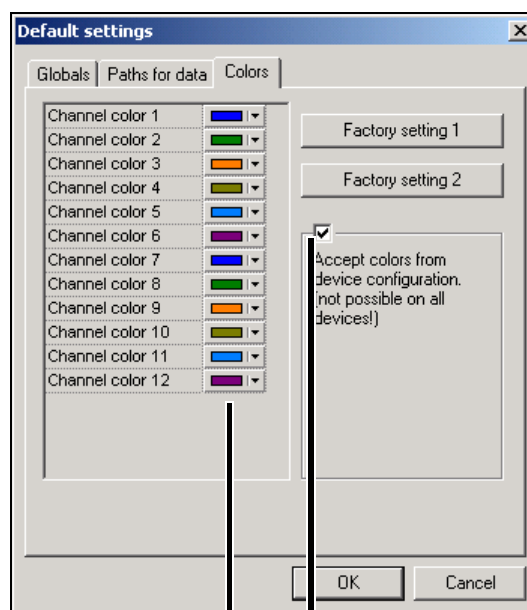

The color setting on the left only applies if you have not marked the box with a tick.

10 Menu functions and toolbar


10.2 Editing

Reset evaluation

This function deletes all files from the evaluation directory. The data are automatically regenerated if you make data visible through *Archive* → *Open*, for example. You can use this function for cleaning up the hard disk from time to time.

Reset archive

Select the archive that is to be reset here.
Caution:
The archive must not be displayed graphically at this moment.

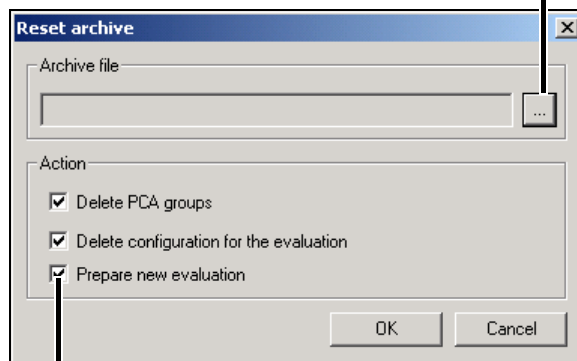

Options for resetting an archive

If no option is activated, only the files belonging to the selected archive will be deleted from the evaluation directory. As with the *Reset evaluation* function, they will be automatically regenerated when the archive is displayed graphically again.

Delete PCA group

If the option is activated, PCA groups (generated within the PCA3000 when an archive is opened) will be deleted. Measurement data will not be lost.

⇒ See “PCA groups” on page 73.

Delete evaluation configuration

This option enables you to undo changes to the *Channels* register.

⇒ “Channels” register: see Chapter 9.2 “Channels”

Prepare new evaluation


When this option is active, the files in the evaluation directory will be freshly created for the specified archive at the end of the function *Reset archive*. This means you will save time at the next graphical display of the archive.

Supplementary description



Device info text

The device info text can be created using the setup program but cannot be edited. Caution: do not confuse “device info text” with “file info text”.

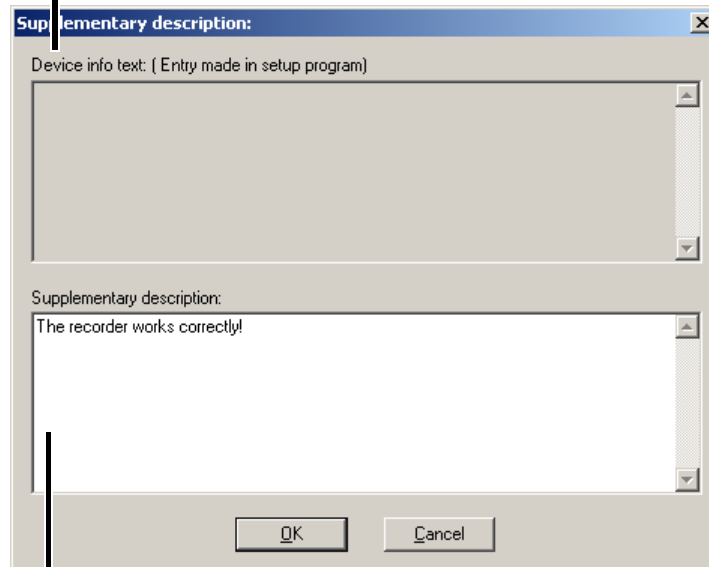

Supplementary description

Here you can enter the additional text.

If a protected archive (Page 30) is created after entering the supplementary description, the information will be permanently linked to the file; it can no longer be deleted.

With all other archives, the “supplementary description” can be deleted again by re-editing or through the function *Edit* → *Reset archives* (option *Delete PCA groups* must be activated).

Sign time period



You can use this function to execute an electronic signature for the process data that are visible in the graphics. If you have previously zoomed, the data that are not visible are not signed.

The signature is entered in the “PC signature for time period” register.

⇒ Chapter 9.8 “Log-off signature (PC signature for time period)”


10 Menu functions and toolbar

10.3 Zoom

Zoom on date and time



After calling up this function, you can zoom the graphics by entering a start time and an end time.

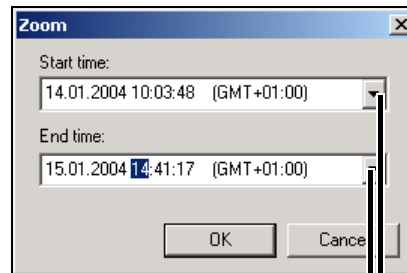

Select date from
calendar


Use the mouse or the tabulator key to move from one field to another. Use the mouse or the cursor keys (left, right) to move from one part of the date to another within the field.

Enter the required time with the number keys. When you have completed the entry with OK, the graphics is displayed.

If you cannot enter an end time, this could mean that this a time prior to the start time. This is not possible.


Zoom X-axis



If this function is active () , you can zoom in the X-direction within the graphics using the left mouse button (position mouse, press left mouse button, move mouse, release left mouse button).


Zoom Y-axis



If this function is active () , you can zoom in the Y-direction within the graphics using the left mouse button (position mouse, press left mouse button, move mouse, release left mouse button).


Zoom X+Y-axes



If this function is active () , you can zoom in the X- and Y-direction within the graphics using the left mouse button (position mouse, press left mouse button, move mouse, release left mouse button).

Show guideline



If this function is active () , a guideline from the current value of the channel to the X- and Y-axis can be switched into display within the graphics by using the left mouse button (position mouse, press left mouse button, then release it).

Reset zoom



This function undoes all magnifications/reductions and presents the complete data for the archive section that has been opened.

Zoom forwards (zoom in)



The next zoomed display can be restored through this function. This function is only available if *Zoom backwards* has been executed. As an alternative to the mouse, *Zoom forwards* can also be executed from the PC keyboard (page up).

10 Menu functions and toolbar

Zoom backwards (zoom out)



The last zoomed display can be restored through this function. It is only available if zooming has been carried out. As an alternative to the mouse, *Zoom backwards* can also be executed from the PC keyboard (page down).

10.4 View

Toolbar

Show/hide toolbar.

Status bar

Show/hide status bar (at the lower end of the software window).

Coordinate bar

Show/hide coordinate bar (at the lower end of the software window, above the status bar).

10.5 Extras

Enable (unlock) program options

If the software has been installed as a viewer (“read-only” mode), then some functions, such as saving, are disabled. This function can be used to register the software at a later stage and so change it to a full version.

Renew log-in / alter password

This function enables the logged-in user to log in freshly and use the options that are also available with a fresh startup of the software.

⇒ Chapter 11 “Options at program start”

Comment in audit trail

This function can be used to make a manual entry in the audit trail. The entries can be visualized by means of the PC Audit Trail Manager software.

⇒ Additional information about the PC Audit Trail Manager software (PCAT) can be found in the Operating Manual B 70.9704.0.

10 Menu functions and toolbar

10.6 Window

Cascade

Several graphical displays (open sections of an archive) are shown overlapping.



In the “Window” menu, the individual names of the open displays are shown and can consequently be selected and displayed.

Tile

Several graphics displays (open sections of an archive) are shown side by side.



Arrange icons


If displays are minimized (click on icon), this function will position all window titles at the lower edge of the screen - several will be positioned next to each other.

Minimize window:



Click here to minimize a window.

Icons arranged:

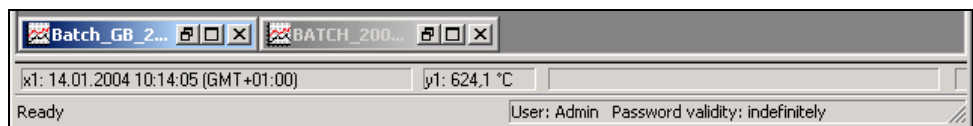

10 Menu functions and toolbar

10.7 Info

Info Here you can obtain information on the version number of the program. Please have this number available if you have technical problems or queries and contact a service representative.

Registered license numbers Here you can obtain information on the license number of the program. Please have this number available if you have technical problems or queries and contact a service representative.


10 Menu functions and toolbar

11 Options at program start

When you start up the PCA3000 software, you have the opportunity of setting various options if log-in has been activated.


Proceed as follows:

- * Start the software
- * Before you log in, left-click on  to show the options.

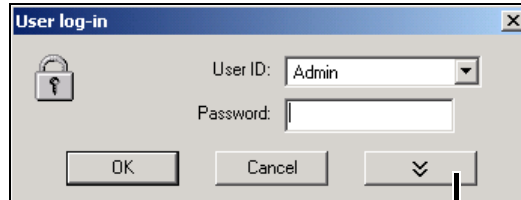

Show options

The dialog window changes to ...

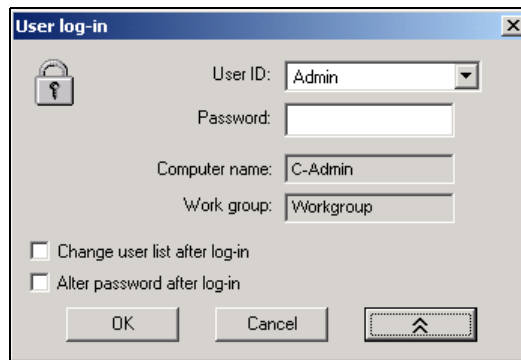

Change user list after log-in

This function is only available if the “Administrator” or “Network user” option was selected during the installation of the software, and only on instruments with an increased security level.

Select the option if you want to activate a different user list after starting the program.

If the installation was made with the “Local user” option, then the function does not read “Change user list after log-in”, but:

Read in new rights file after log-in.

Alter password after log-in

Select this option if you want to alter your password after starting the program.

11 Options at program start

A

- Administrator 11
- After log-in, alter password 85
- After log-in, change user list 85
- After log-in, read in new rights file 85
- Altering
 - column width 49
 - row height 49
- Archive 22–23
 - open 24, 33, 73
 - reset 78
- Archive file 31
- Archive reset
 - delete evaluation configuration 78
 - delete PCA group 78
 - prepare new evaluation 78
- Audit trail filtering 57

B

- Batch 58
 - continue search 59
 - filtering 59
 - info 37
 - open 75
 - search 36, 59
 - sign 60
- Batch information 60
- Batch period
 - scroll 59
 - synchronize 59
 - zoom 59

C

- Channel color 46
- Channel description 47
- Channel display 46
- Channel name 47
- Channel unit, display of 47
- Clipboard 71
- Close 75
- Column width
 - adjust 52, 55, 61
 - alter 49
- Column width and row height, adjusting of 52, 55, 61
- Comment in audit trail 81
- Commissioning 7
- CompactFlash 22, 75
- Continue search 59

12 Index

Coordinate bar *19, 81*
Copying *52, 55, 61*

D

Data
 read-in *22, 75*
 save *28, 76*
 save as *28, 30, 76*
Data export *70*
Data sets
 copy *55, 61*
 export *55, 61*
 filtering *54*
 mark *54*
 scroll *54*
 synchronize *54*
Default settings *76*
 colors *77*
 file deposit *77*
 general *76*
Demo version *14*
Device language *73*
Device-specific variables *67–68*

E

Electronic signature, opening of *75*
Evaluation *22–24*
 prepare freshly *78*
 reset *78*
Evaluation configuration, deleting of *78*
Evaluation directory *31*
Export *52, 55, 61, 70*
 through text file *70*
 via clipboard *71*

F

File deposit *31*
Filter audit trail *57*
Filtering *54, 57, 59, 63*
Footer *67*
Full-text search *37*

G

Graphical representation *33*
Graphics area *33, 35*
Graphics properties *38*

Guide 21

H

Header 67

I

Info 83

Installation 13, 15

K

Keys 9

L

License agreement 13

License number 14

License numbers 14

Line type 46

Line width 46

M

Marking 52, 54

all 52

column 51

row 51

section 50

Marking a column 51

Marking a row 51

Marking a section 50

Marking all 52

Measurement data read-in 22

Measurement data visualization 24

Menu bar 19

N

Note signs 8

O

Opening 73

Options at program start 85

P

- Page setup 69
- Password alteration 81
- PCA groups 25, 73
- PCA groups, deleting of 78
- Print
 - print 38
 - print preview 38
 - printer setup 38
- Print preview 67, 76
- Printer setup 69, 76
- Printing 38, 67, 76
- Processing in EXCEL 71
- Program options, enabling of 81
- Properties 38
 - actions for left mouse button 38
 - display all measurements 40
 - display ratio 38
 - font size 39
 - speed 39
 - zoom 39
- Protected archives 28, 30, 79

R

- Ratio of displayed measured values ... 47
- Recipe 60
- Recipe data 60
- Register 41
- Registered license numbers 83
- Renew log-in 81
- Report 49
- Representation 9
- Row height, adjusting of 52, 55, 61
- Row height, alteration of 49

S

- Save diagram as bitmap 40
- Save diagram as Jpeg 40
- Scaling end 47
- Scaling start 47
- Screen texts 9
- Scroll 51, 54, 59
- Search 59
- Show guideline 80
- Signature filtering 63
- Software available 14
- Software installation 13
- Status bar 81

Supplementary description 79
Synchronizing 51, 54, 59

T

Table
 analog group 65
 audit trail 56
 batches 58
 channels 45
 digital group 66
 events 53
 PC signature for batches 62
 PC signature for log-off 64
 report 49
 signature for batches 62
 signature for log-off 64
Table area 33, 41
Time period
 copy 52
 scroll 51
 sign 37
 signing 79
 synchronize 51
 zoom 51
Time period selection 26
Toolbar 19, 81
Toolbar, shifting of 20

W

Warning signs 8
Warranty 7
Window
 arrange icons 82
 cascade 82
 tile 82
Working area 19–20

Y

Y-axis type 47

Z

Zoom
 in 37, 80
 out 37, 81
 reset 37, 80
Zoom on date and time 80

12 Index

Zoom X+Y-axes 80
Zoom X-axis 80
Zoom Y-axis 80
Zooming 37, 51, 59, 80



JUMO GmbH & Co. KG

Street address:
Moltkestraße 13 - 31
36039 Fulda, Germany
Delivery address:
Mackenrodtstraße 14
36039 Fulda, Germany
Postal address:
36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
e-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow, Essex CM20 2TT, UK
Phone: +44 1279 635533
Fax: +44 1279 635262
e-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
e-mail: info@jumo.us
Internet: www.jumo.us